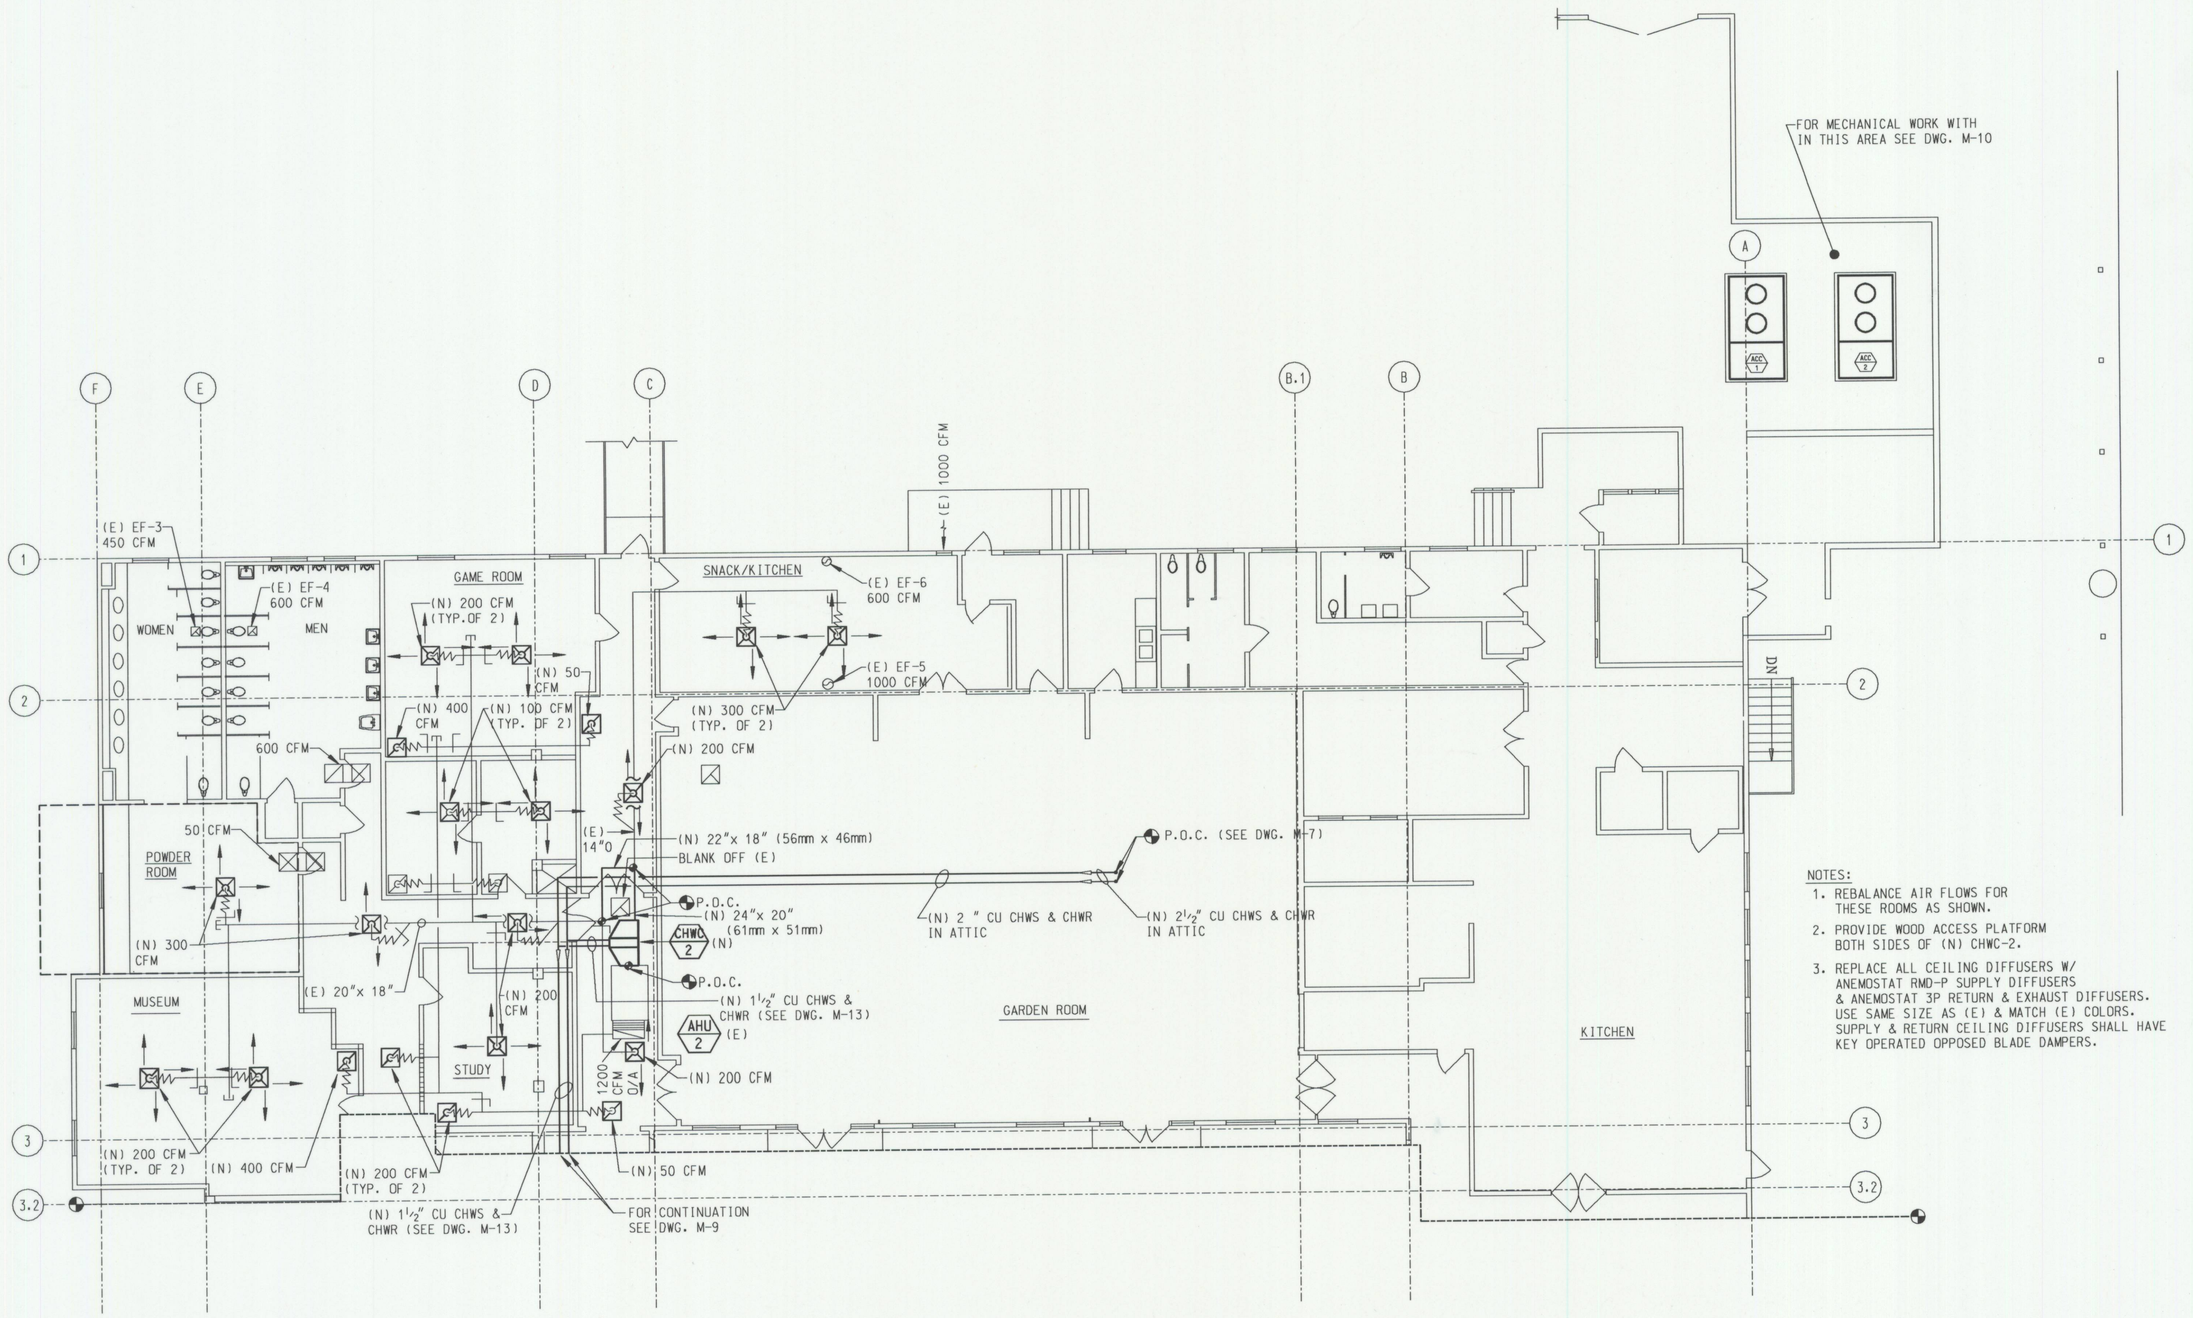

NOTES:

1. REBALANCE AIR FLOWS FOR THESE ROOMS AS SHOWN.
2. PROVIDE WOOD ACCESS PLATFORM BOTH SIDES OF (N) CHWC-2.
3. REPLACE ALL CEILING DIFFUSERS W/ ANEMOSTAT RMD-P SUPPLY DIFFUSERS & ANEMOSTAT 3P RETURN & EXHAUST DIFFUSERS. USE SAME SIZE AS (E) & MATCH (E) COLORS. SUPPLY & RETURN CEILING DIFFUSERS SHALL HAVE KEY OPERATED OPPOSED BLADE DAMPERS.

FLOOR PLAN - NORTH (PHASE 4)

SCALE: 1/8"=1'-0"

NORTH

1/8" = 1'-0" 5' 0' 5' 10' 20'

1m 0m 1m 2m 5m 10m

REV. NO.	DATE	DESCRIPTION	AGENCY	BY

COORDINATED

PROJECT MANAGER		DATE
SECURITY		DATE
ENVIRONMENTAL		DATE
SAFETY DIVISION		DATE
CHIEF FIRE PROTECTION		DATE
COMMUNICATIONS ENGINEER		DATE
BIOENVIRONMENTAL ENGINEER		DATE
CHIEF OPERATION & MAINTENANCE		DATE

APPROVED

USING AGENCY		DATE
BASE CIVIL ENGINEER		DATE
CONTRACT MGT.		DATE
DESIGNED BY	JOHN WILLIAMS	6/15/97
DRAWN BY	BILL WHORLEY	6/15/97
CHECKED BY	JOHN WILLIAMS	6/15/97
SUBMITTED BY	JOHN HOLLAND	6/15/97

JOB No. 10-50104-18B

MERIT ENGINEERING, INC.
129 SOUTH SAN FERNANDO BLVD.
BURBANK, CA. 91502
(818) 842-2020 FAX (818) 842-1419

REGISTERED PROFESSIONAL ENGINEER JOHN B. WILLIAMS MECHANICAL EXP. 6-30-99 STATE OF CALIFORNIA 6-12-97

UNITED STATES AIR FORCE

61 AIR BASE GROUP (ABG)
LOS ANGELES AIR FORCE BASE

PROJECT TITLE: BLDG 403 HVAC (PHASE 4) COMMUNITY CENTER FORT MacARTHUR

SHEET TITLE: FLOOR PLAN - NORTH (PHASE 4)

DRAWING NO. HHEK - 95-0019

DATE: 6/15/97

SCALE: 1/8" = 1'-0"

M-8

SHEET: 9 OF 16