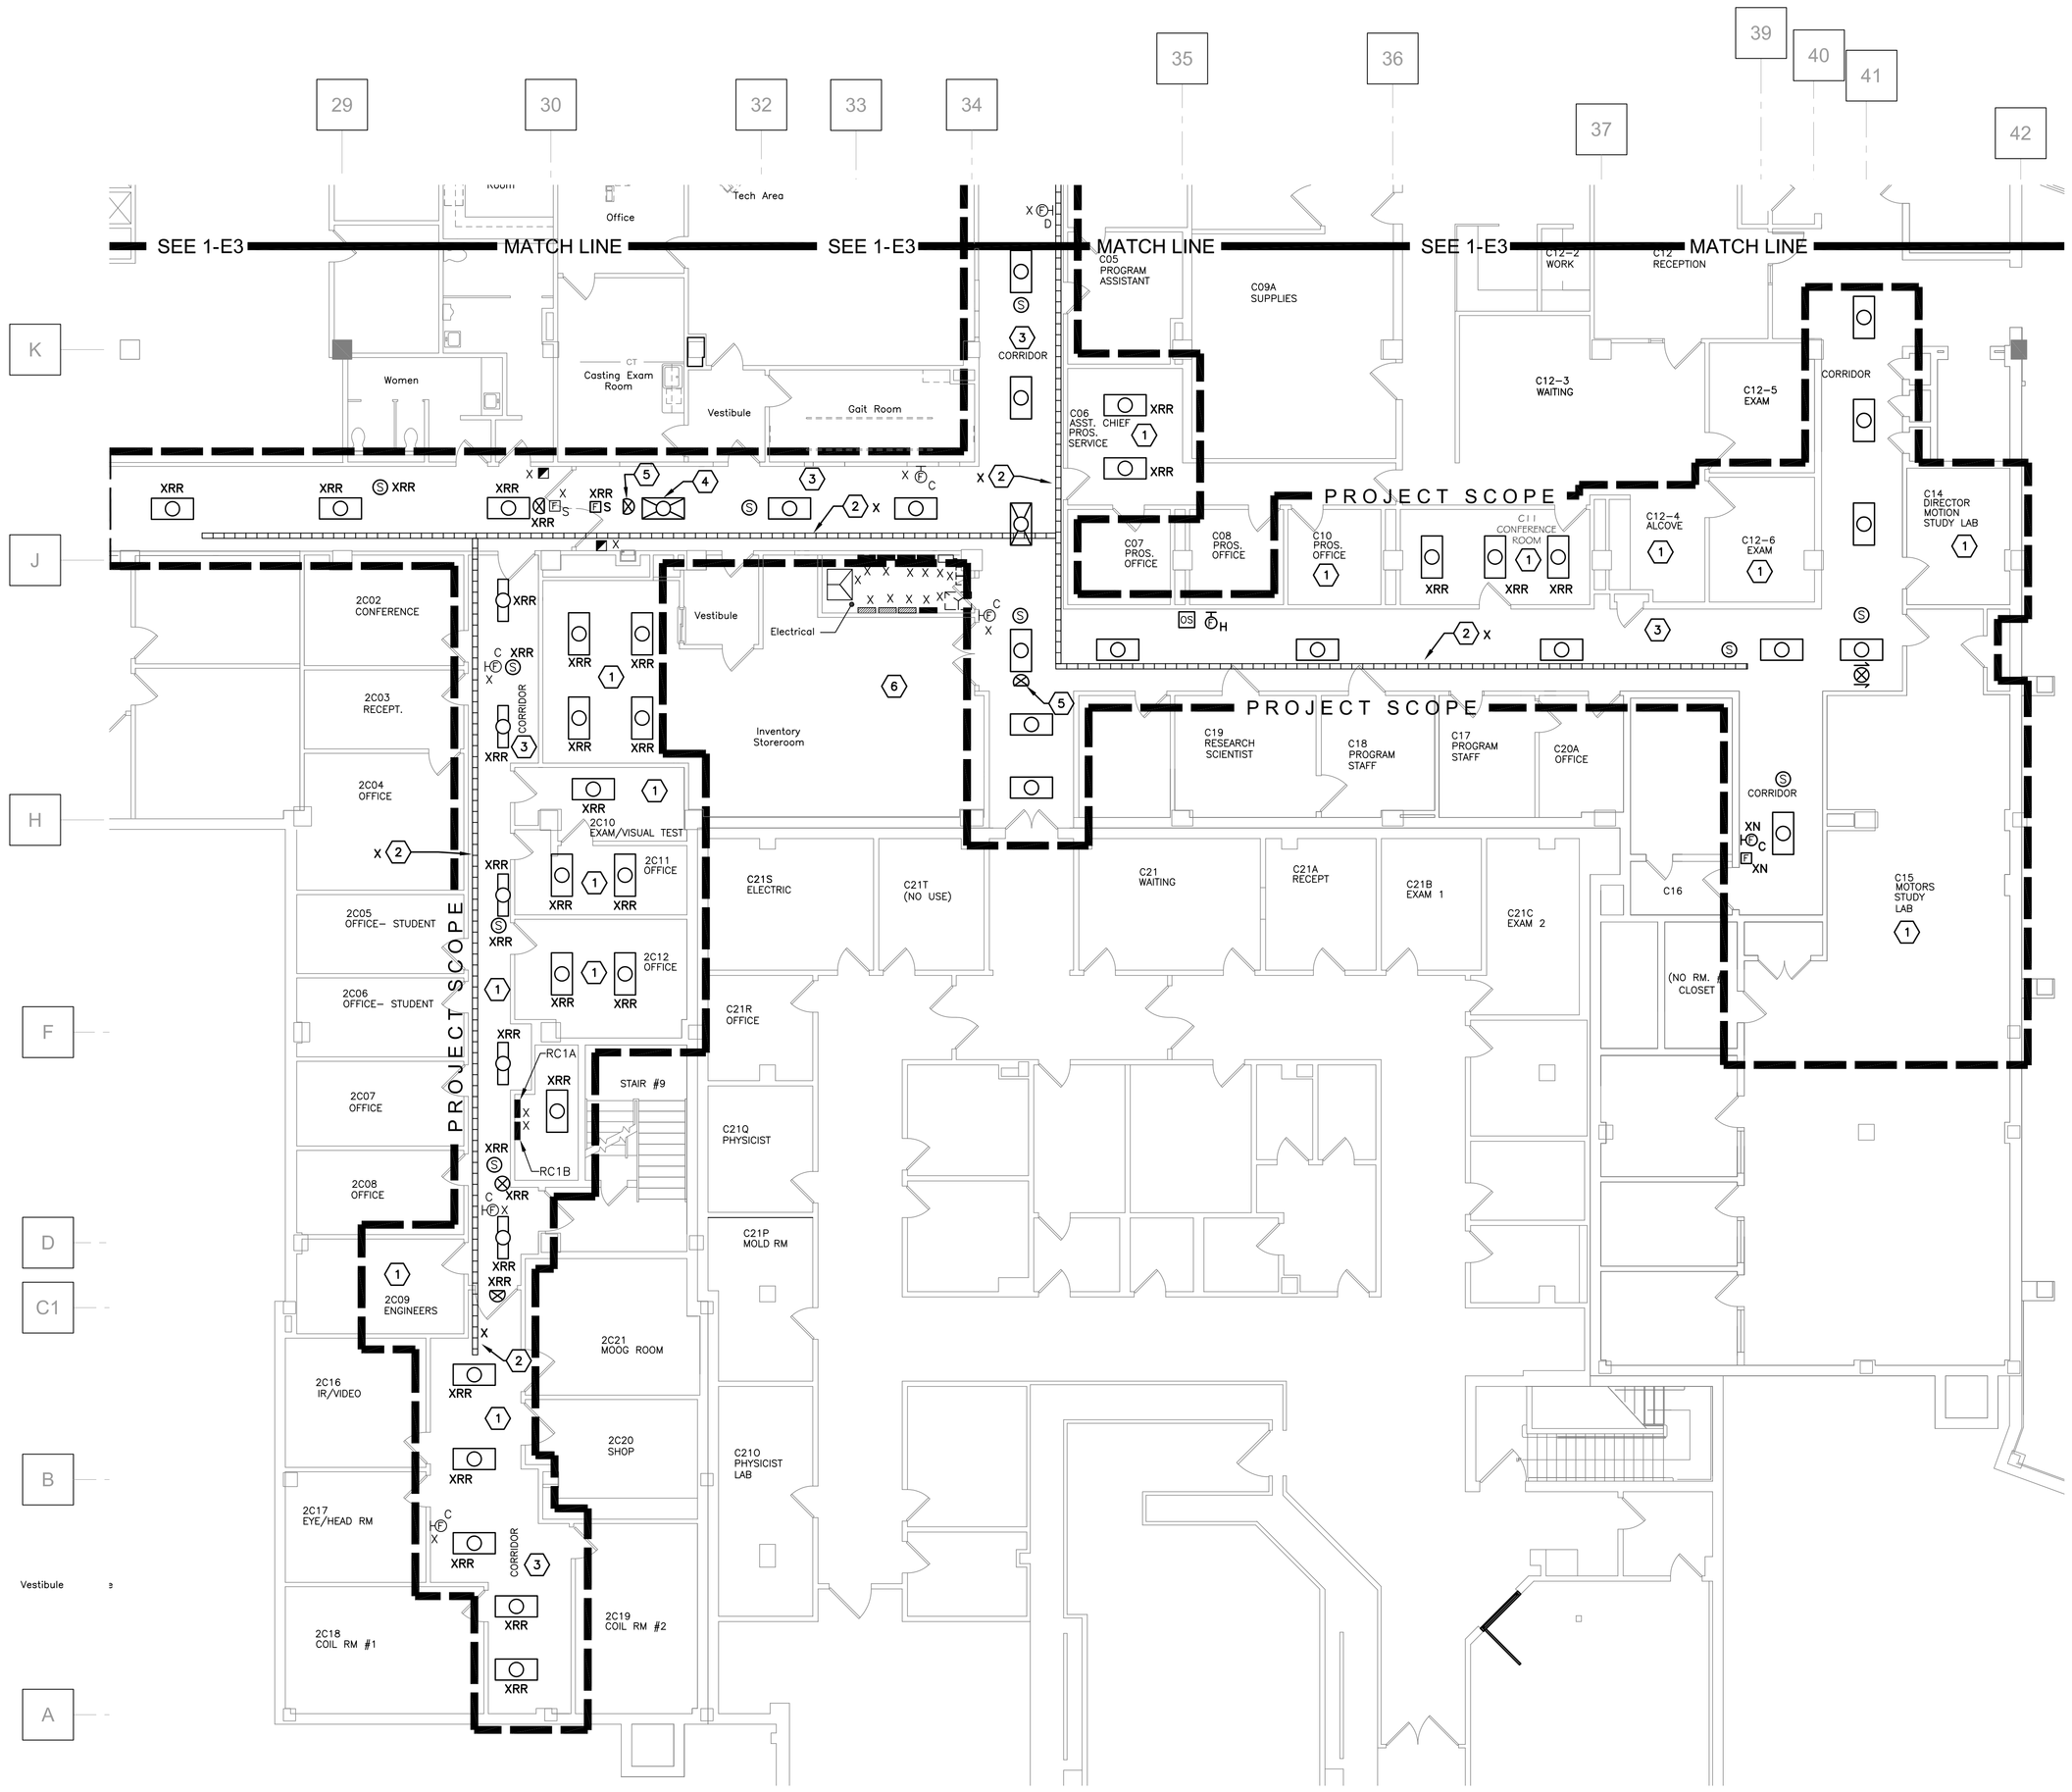

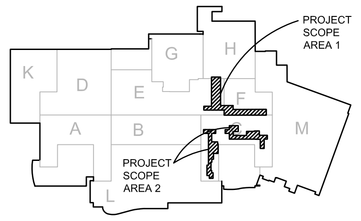

KEY PLAN - BASEMENT

Scale = None

ELECTRICAL DEMOLITION GENERAL NOTES:

D1. ALL EXISTING LIGHTING FIXTURES, RECEPTACLES, SPECIAL SYSTEMS OUTLETS, CONDUIT, WIRING ETC. THAT WILL NOT BE REUSED IN THE REMODELED INSTALLATION SHALL BE REMOVED UNLESS OTHERWISE NOTED. THIS DEMOLITION SHALL INCLUDE ALL ELECTRICAL ITEMS SHOWN ON THIS PLAN THAT ARE NOT DESIGNATED BY "X", "XN" OR "XRR" AND ALL OTHER ADDITIONAL ITEMS THAT ARE NOT SHOWN BUT THAT MUST BE REMOVED IN ORDER TO PRODUCE A NEAT, FINISHED, PROPERLY FUNCTIONING ELECTRICAL INSTALLATION. MAINTAIN CIRCUIT CONTINUITY TO ALL EXISTING REUSED ELECTRICAL SYSTEMS COMPONENTS – PROVIDE ALL CONDUIT AND WIRING NECESSARY TO ACHIEVE THE SAME. THE CONTRACTOR SHALL FIELD VERIFY THE NATURE AND EXTENT OF ALL DEMOLITION WORK AND SHALL INCLUDE COST FOR THE SAME IN THE BID SUBMITTAL.

D2. ALL EXISTING REMOVED ELECTRICAL EQUIPMENT, DEVICES, ETC. THAT ARE NOT RETAINED BY THE OWNER SHALL BE DISPOSED OF BY THE ELECTRICAL CONTRACTOR.

D3. DASHED WALLS ON PLAN INDICATE EXISTING CONSTRUCTION TO BE REMOVED.

D4. REFER TO ELECTRICAL LEGEND FOR ALL SYMBOL DESIGNATIONS. NOTE SPECIAL ATTENTION TO SELECTED EXISTING DEVICES, WIREWAYS, ETC. MARKED XB, XRR OR XN, AND REMOVE/BLANK OFF, RELOCATE OR REPLACE THESE COMPONENTS AS REQUIRED.

D5. MAINTAIN CIRCUIT CONTINUITY TO ALL EXISTING ELECTRICAL SYSTEM COMPONENTS IN AREAS NOT BEING REMODELED UNLESS OTHERWISE NOTED. PROVIDE ALL CONDUIT AND WIRING EXTENSIONS NECESSARY TO ACHIEVE SAME.

D6. THE ELECTRICAL CONTRACTOR SHALL CLOSELY COORDINATE ALL ELECTRICAL DEMOLITION WORK WITH THE GENERAL AND MECHANICAL CONTRACTORS, AND SHALL DISCONNECT ALL REQUIRED CIRCUITS IN A TIMELY MANNER.

D7. CONTACT THE ENGINEER IF A QUESTION SHOULD ARISE CONCERNING THE STATUS OF ANY OUTLET, DEVICE, LIGHTING FIXTURE, ETC.

D8. REFER TO ARCHITECTURAL PLANS FOR PHASING AND CONSTRUCTION SCHEDULING NOTES.

CODED NOTES:

1. REMOVE EXISTING CEILING MOUNTED DEVICES (LIGHTING FIXTURES, SPEAKERS, OCCUPANCY SENSORS, ETC) AS REQUIRED FOR MECHANICAL WORK TO OCCUR ABOVE FINISHED CEILING. REINSTALL DEVICES AFTER WORK IS COMPLETE. CLEAN AND RELAMP LIGHTING FIXTURES – MATCH EXISTING LAMP TYPE.
2. EXISTING CABLE TRAY ABOVE FINISHED CEILING TO REMAIN. MAINTAIN EXISTING CABLING ROUTED IN CABLE TRAY AND CONTINUITY TO ALL EXISTING TCO'S SERVED BY THE CABLING. PROTECT CABLING FROM DAMAGE WHILE MECHANICAL WORK ABOVE FINISHED CEILING OCCURS.
3. EC SHALL REWORK ANY EXISTING BRANCH CIRCUIT CONDUIT AND WIRING ABOVE FINISHED CEILING AS NECESSARY FOR MC TO INSTALL NEW DUCT WORK. TYPICAL FOR CORRIDORS AND ROOMS WITHIN PROJECT SCOPE LINE.
4. REUSE EXISTING LIFE SAFETY CIRCUIT TO SUPPLY NEW FIXTURES AS INDICATED ON LIGHTING PLAN.
5. REUSE EXIT SIGN FOR INTERIM LIFE SAFETY PLAN WHILE TEMPORARY CONSTRUCTION WALLS ARE IN USE.
6. REFER TO "ELECTRICAL ROOM ENLARGED PLAN" ON POWER DISTRIBUTION ONE LINE DIAGRAM DRAWING.

PARTIAL BASEMENT FLOOR
ELECTRICAL DEMOLITION PLAN
AREA 2

SCALE: 1/8" =1'-0"

0 4' 8' 16'

FULLY SPRINKLERED

Bid Issue	05-16-08
Revisions:	Date

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

STATE OF OHIO
M.P. LONG
59459
REGISTERED
PROFESSIONAL ENGINEER
07073

ARCHITECT:

Perspectus architecture
13212 Shaker Square Suite 204 Cleveland, Ohio 44120
P. 216.752.1800 F.216.752.3833

DESIGN AND CONSTRUCTION DOCUMENTS AS INSTRUMENTS OF SERVICE ARE GIVEN IN CONFIDENCE AND REMAIN THE PROPERTY OF PERSPECTUS ARCHITECTURE. THE USE OF THIS DESIGN AND THESE CONSTRUCTION DOCUMENTS FOR PURPOSES OTHER THAN THE SPECIFIC PROJECT NAMED HEREIN IS STRICTLY PROHIBITED WITHOUT THE EXPRESSED WRITTEN CONSENT OF PERSPECTUS ARCHITECTURE.

Drawing Title: **PARTIAL BASEMENT FLOOR ELECTRICAL DEMO. PLAN AREA 2**

Approved: Project Director

Project Title: **PROSTHETICS RENOVATIONS**

Location: **VAMC - WADE PARK**

Date: 03-12-08 | Checked: **MPL** | Drawn: **TAG**

Project Number: 541-05-1071

Building Number: **1**

Drawing Number: **1-E4**

Dwg. of

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978