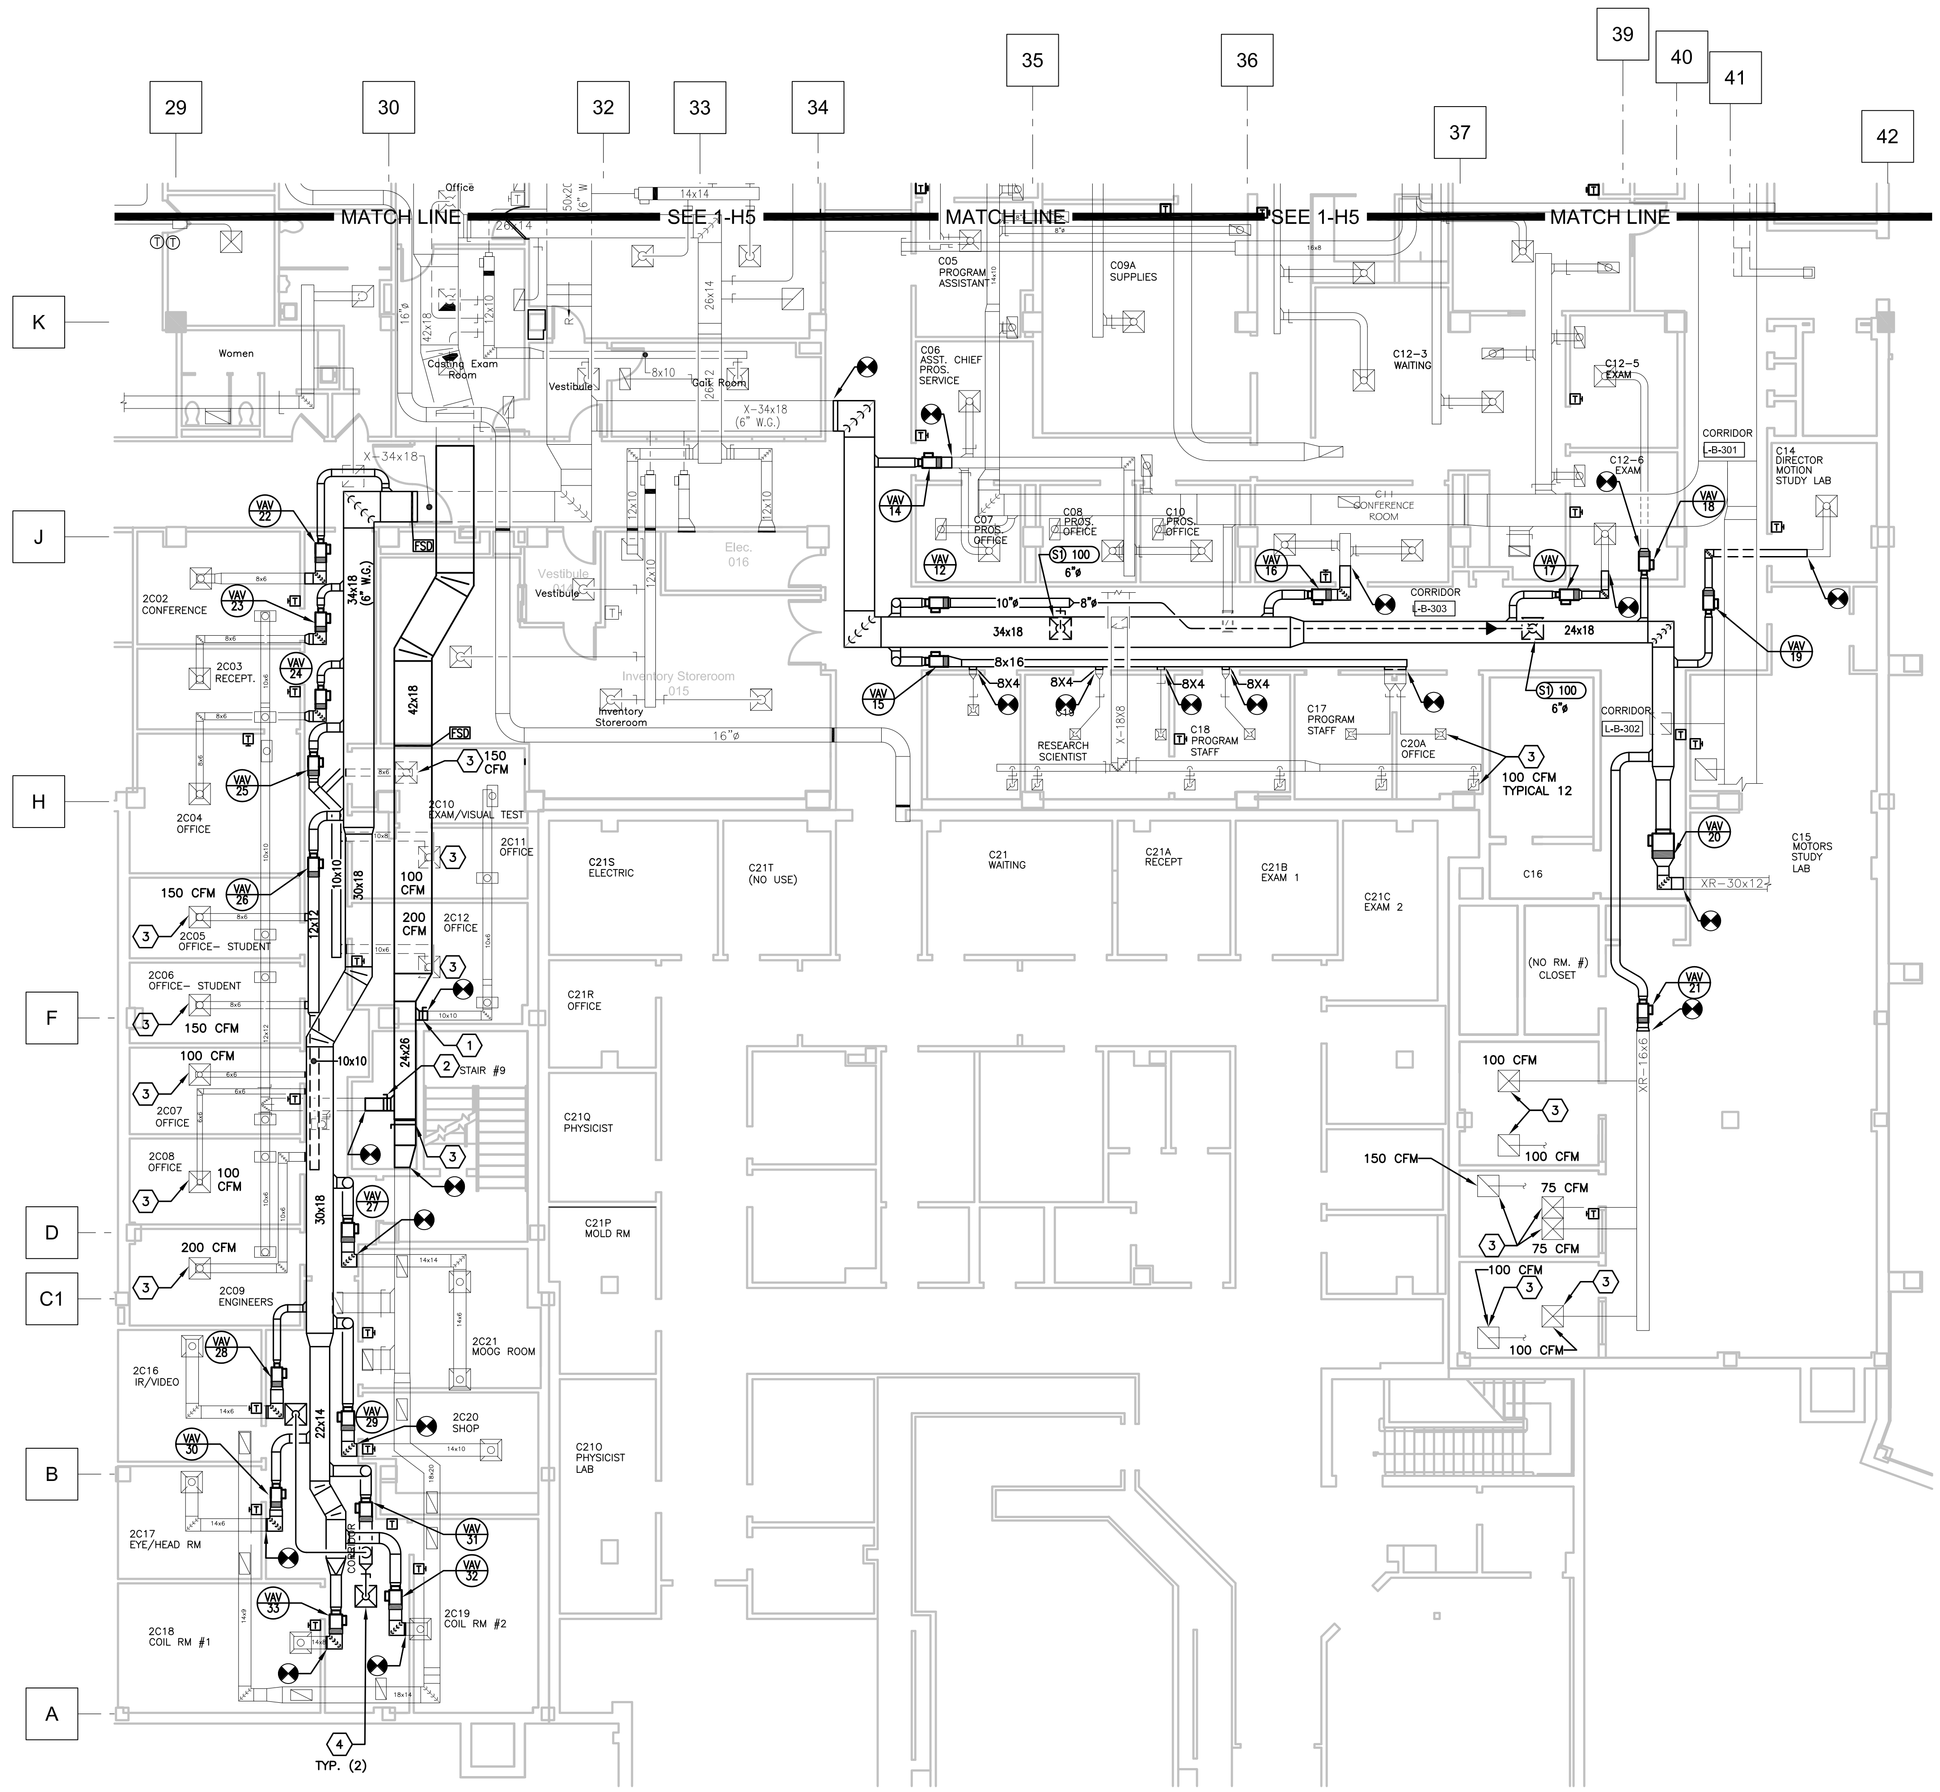

PARTIAL BASEMENT FLOOR
HVAC DUCTWORK PLAN – AREA 2
SCALE: 1/8" =1'–0"

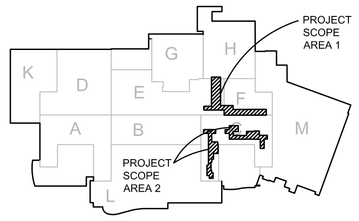

KEY PLAN - BASEMENT
Scale = None

CODED NOTES:

1. BALANCE AIR FLOW TO 450 CFM.
2. BALANCE AIR FLOW TO 1250 CFM.
3. BALANCE EXISTING GRILLE/DIFFUSER TO INDICATED AIR FLOW.
4. RELOCATED SUPPLY DIFFUSER. BALANCE AIRFLOW TO 450 CFM.

GENERAL NOTES:

A. CUT AND PATCH EXISTING WALLS AS REQUIRED TO INSTALL NEW DDC THERMOSTATS. PAINT WALL TO MATCH EXISTING.

B. PROVIDE MANUAL BALANCING DAMPERS TO ALL RECONNECTED BRANCH DUCTS. EXCEPTION: WHERE VAV BOX SERVES SINGLE DIFFUSER.

C. REFER TO ARCHITECTURAL PLANS FOR PHASING AND CONSTRUCTION SCHEDULING NOTES.

FULLY SPRINKLERED

Revisions:	Date
1 Bid Issue	05-16-08

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546–9696
FAX: (440) 546–9699

STATE OF OHIO — BRIAN M. WIDOWSKI E-66625 — REGISTERED PROFESSIONAL ENGINEER
07073

ARCHITECT:

Perspectus architecture
13212 Shaker Square Suite 204 Cleveland, Ohio 44120
P. 216.752.1800 F.216.752.3833

DESIGN AND CONSTRUCTION DOCUMENTS AS INSTRUMENTS OF SERVICE ARE GIVEN IN CONFIDENCE AND REMAIN THE PROPERTY OF PERSPECTUS ARCHITECTURE. THE USE OF THIS DESIGN AND THESE CONSTRUCTION DOCUMENTS FOR PURPOSES OTHER THAN THE SPECIFIC PROJECT NAMED HEREIN IS STRICTLY PROHIBITED WITHOUT THE EXPRESSED WRITTEN CONSENT OF PERSPECTUS ARCHITECTURE.

Drawing Title: **PARTIAL BASEMENT FLOOR PLAN AREA 2 HVAC DUCTWORK**

Approved: Project Director

Project Title: **PROSTHETICS RENOVATIONS**

Project Number: 541-05-1071

Building Number: 1

Location: **VAMC - WADE PARK**

Date: 03-12-08 | Checked: BMW | Drawn: LDH

Drawing Number: **1-H6**

Dwg. of

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08–6231, OCT 1978