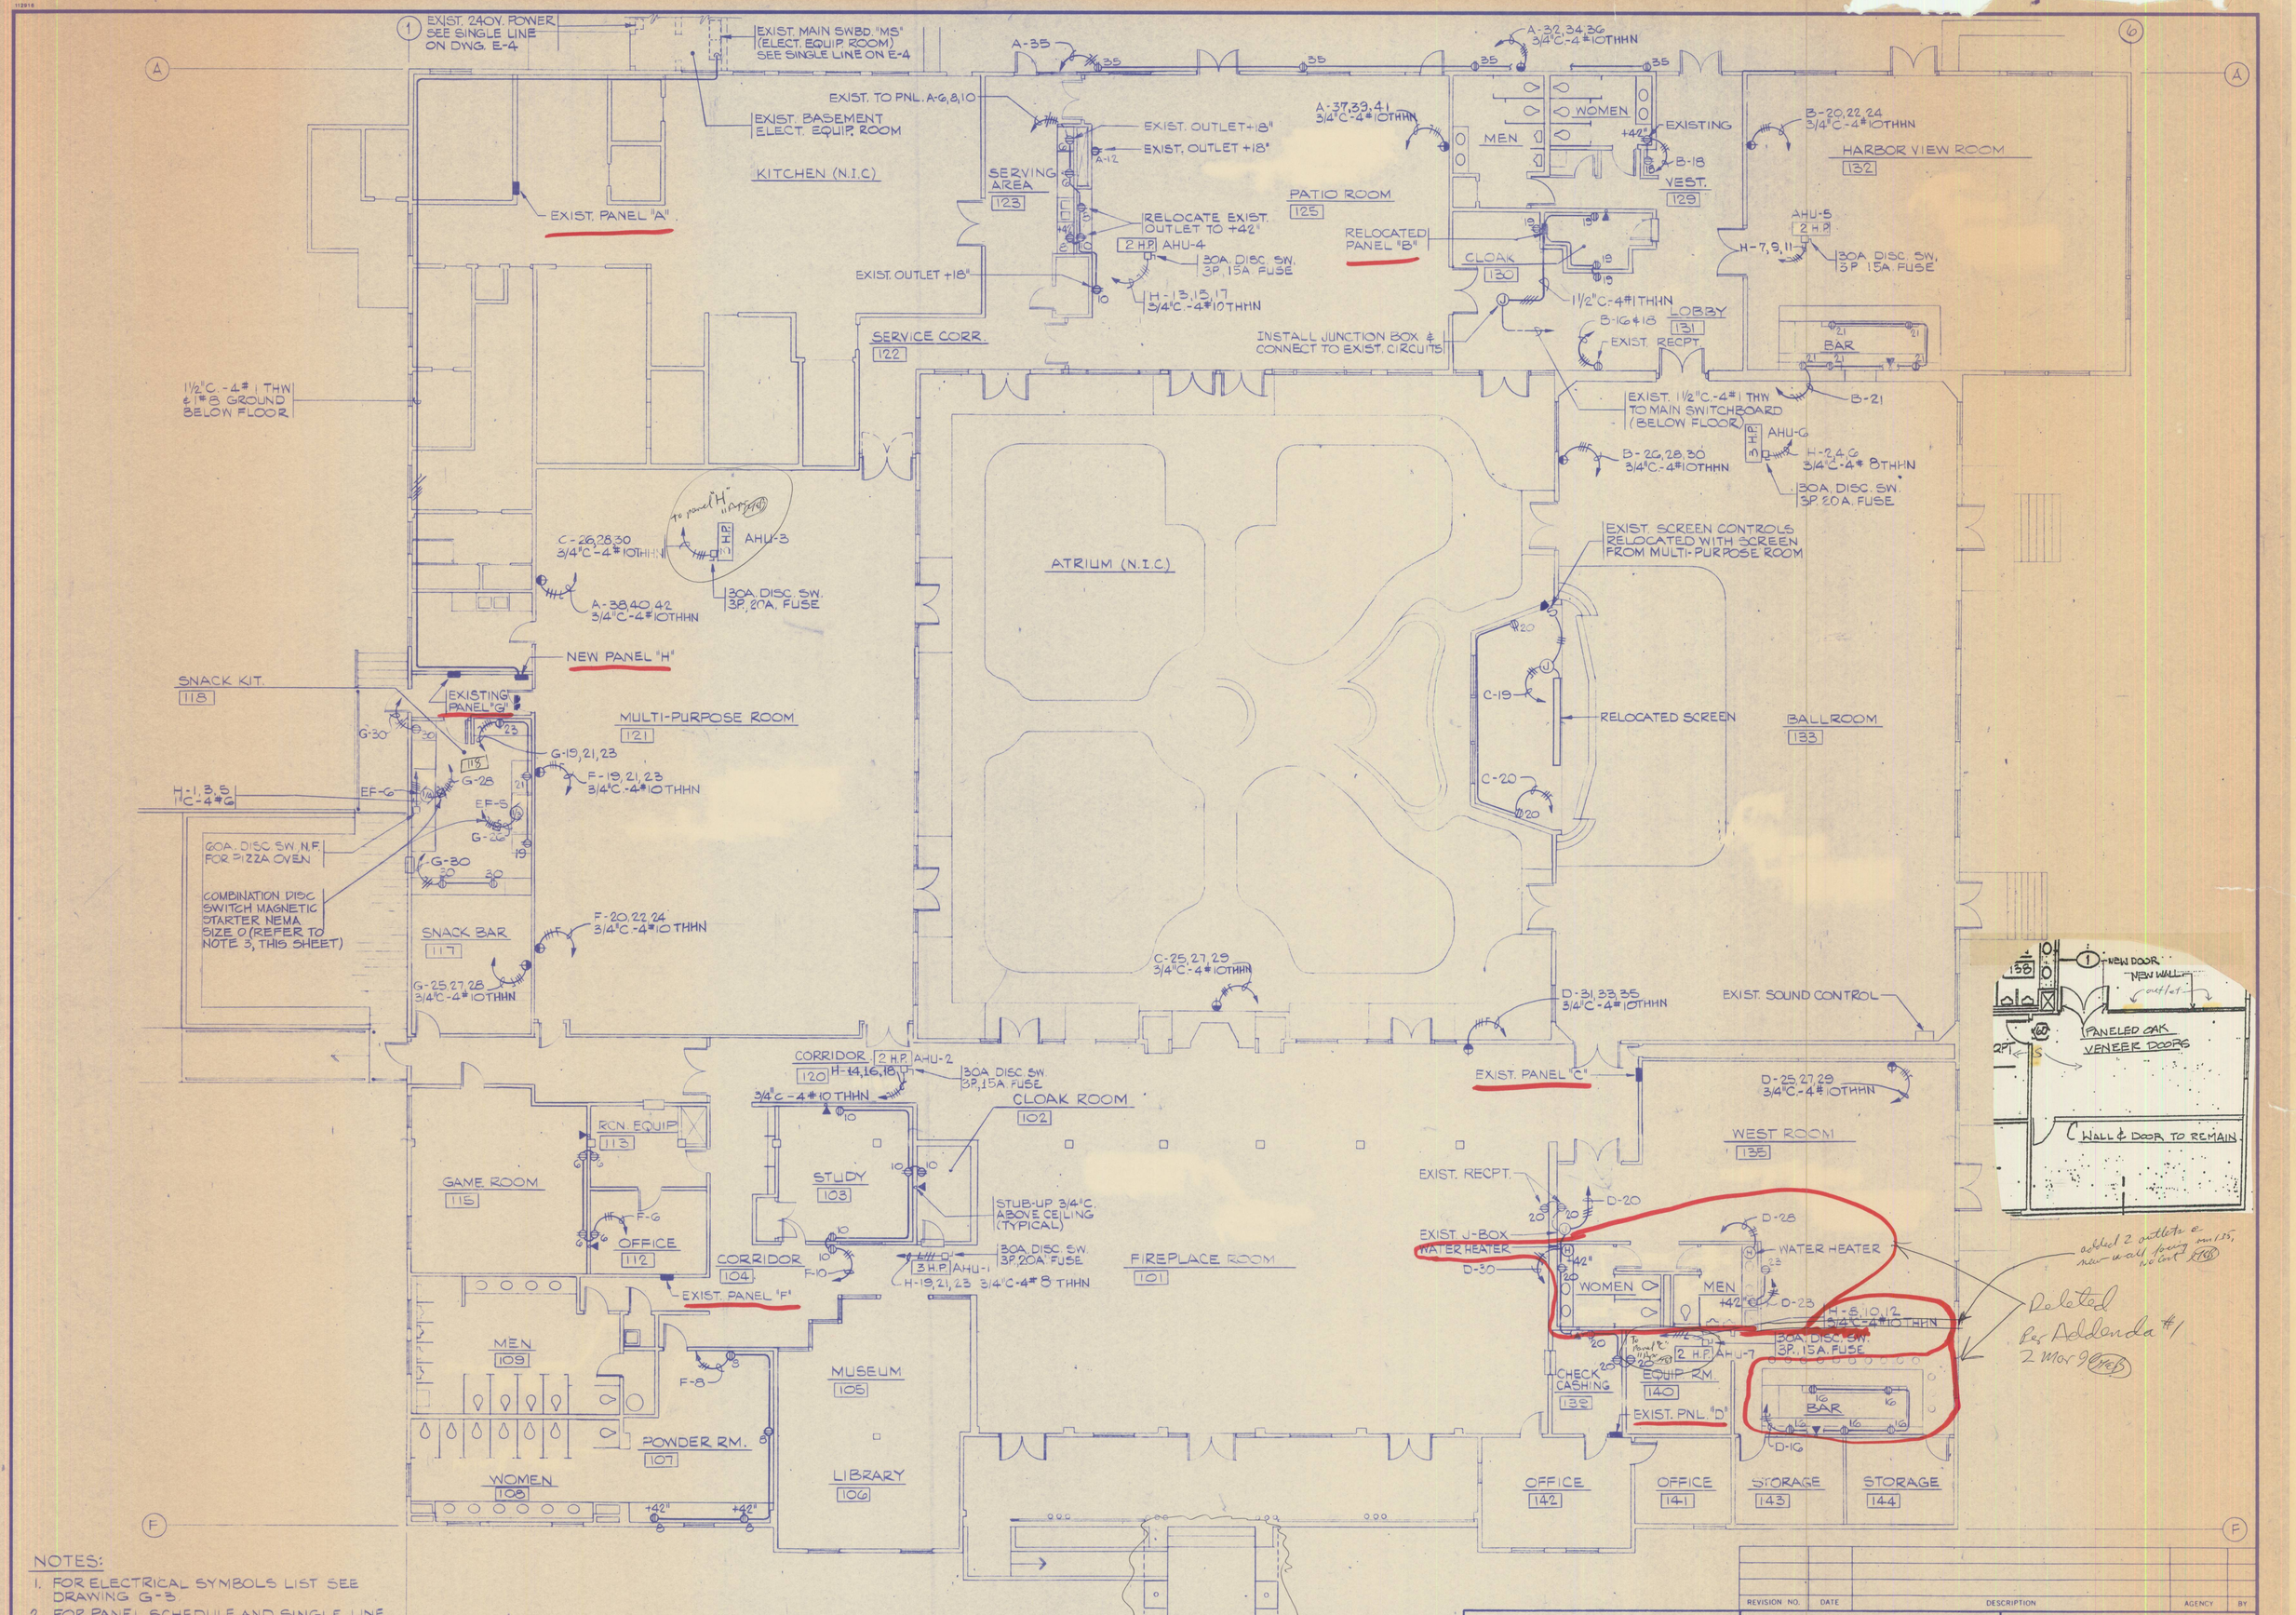

NOTES:

1. FOR ELECTRICAL SYMBOLS LIST SEE DRAWING G-3.
2. FOR PANEL SCHEDULE AND SINGLE LINE DIAGRAM, SEE DWG. E-4.
3. EXHAUST FAN SHALL BE ON WHEN AH-2 IS RUNNING. PROVIDE INTERLOCK (CONDUIT AND WIRING) FROM AH-2 PANEL TO FAN STARTER. ALSO REFER TO NOTE 12 ON DWG. M-1.

ELECTRICAL - POWER PLAN

SCALE: 1/8" = 1'-0"

north

REVISION NO.	DATE	DESCRIPTION	AGENCY	BY

GRAPHIC SCALE 1/8" : 1'-0" 8' 4' 0' 8' 16'

MANAGER ENGINEER — DATE

COORDINATED: SECURITY — DATE; SAFETY DIVISION — DATE; CHIEF FIRE PROTECTION — DATE; COMMUNICATIONS ENGINEER — DATE; BIOENVIRONMENTAL ENGINEER — DATE

APPROVED: USING AGENCY — DATE; BASE CIVIL ENGINEER — DATE

Pan Am World Services, Inc.

UNITED STATES AIR FORCE
HQ 6592d SUPPORT GROUP (AFSG)
LOS ANGELES AIR FORCE BASE

DESIGNED BY E.H.
DRAWN BY E.H.
CHECKED BY S.P.
SUBMITTED BY — DATE

RENOVATE BUILDING 403
COMMUNITY CENTER
LAO 89-1028
FORT Mac ARTHUR, CALIFORNIA
LOS ANGELES AIR FORCE BASE

ELECTRICAL - POWER PLAN

SPECIFICATION NO. 6592/DE 9010289
DATE 10/16/89 — SCALE 1/8" = 1'-0"
DRAWING NUMBER 00403-5010289 (ATCH. 3) — E-1
SHEET 45 OF 48