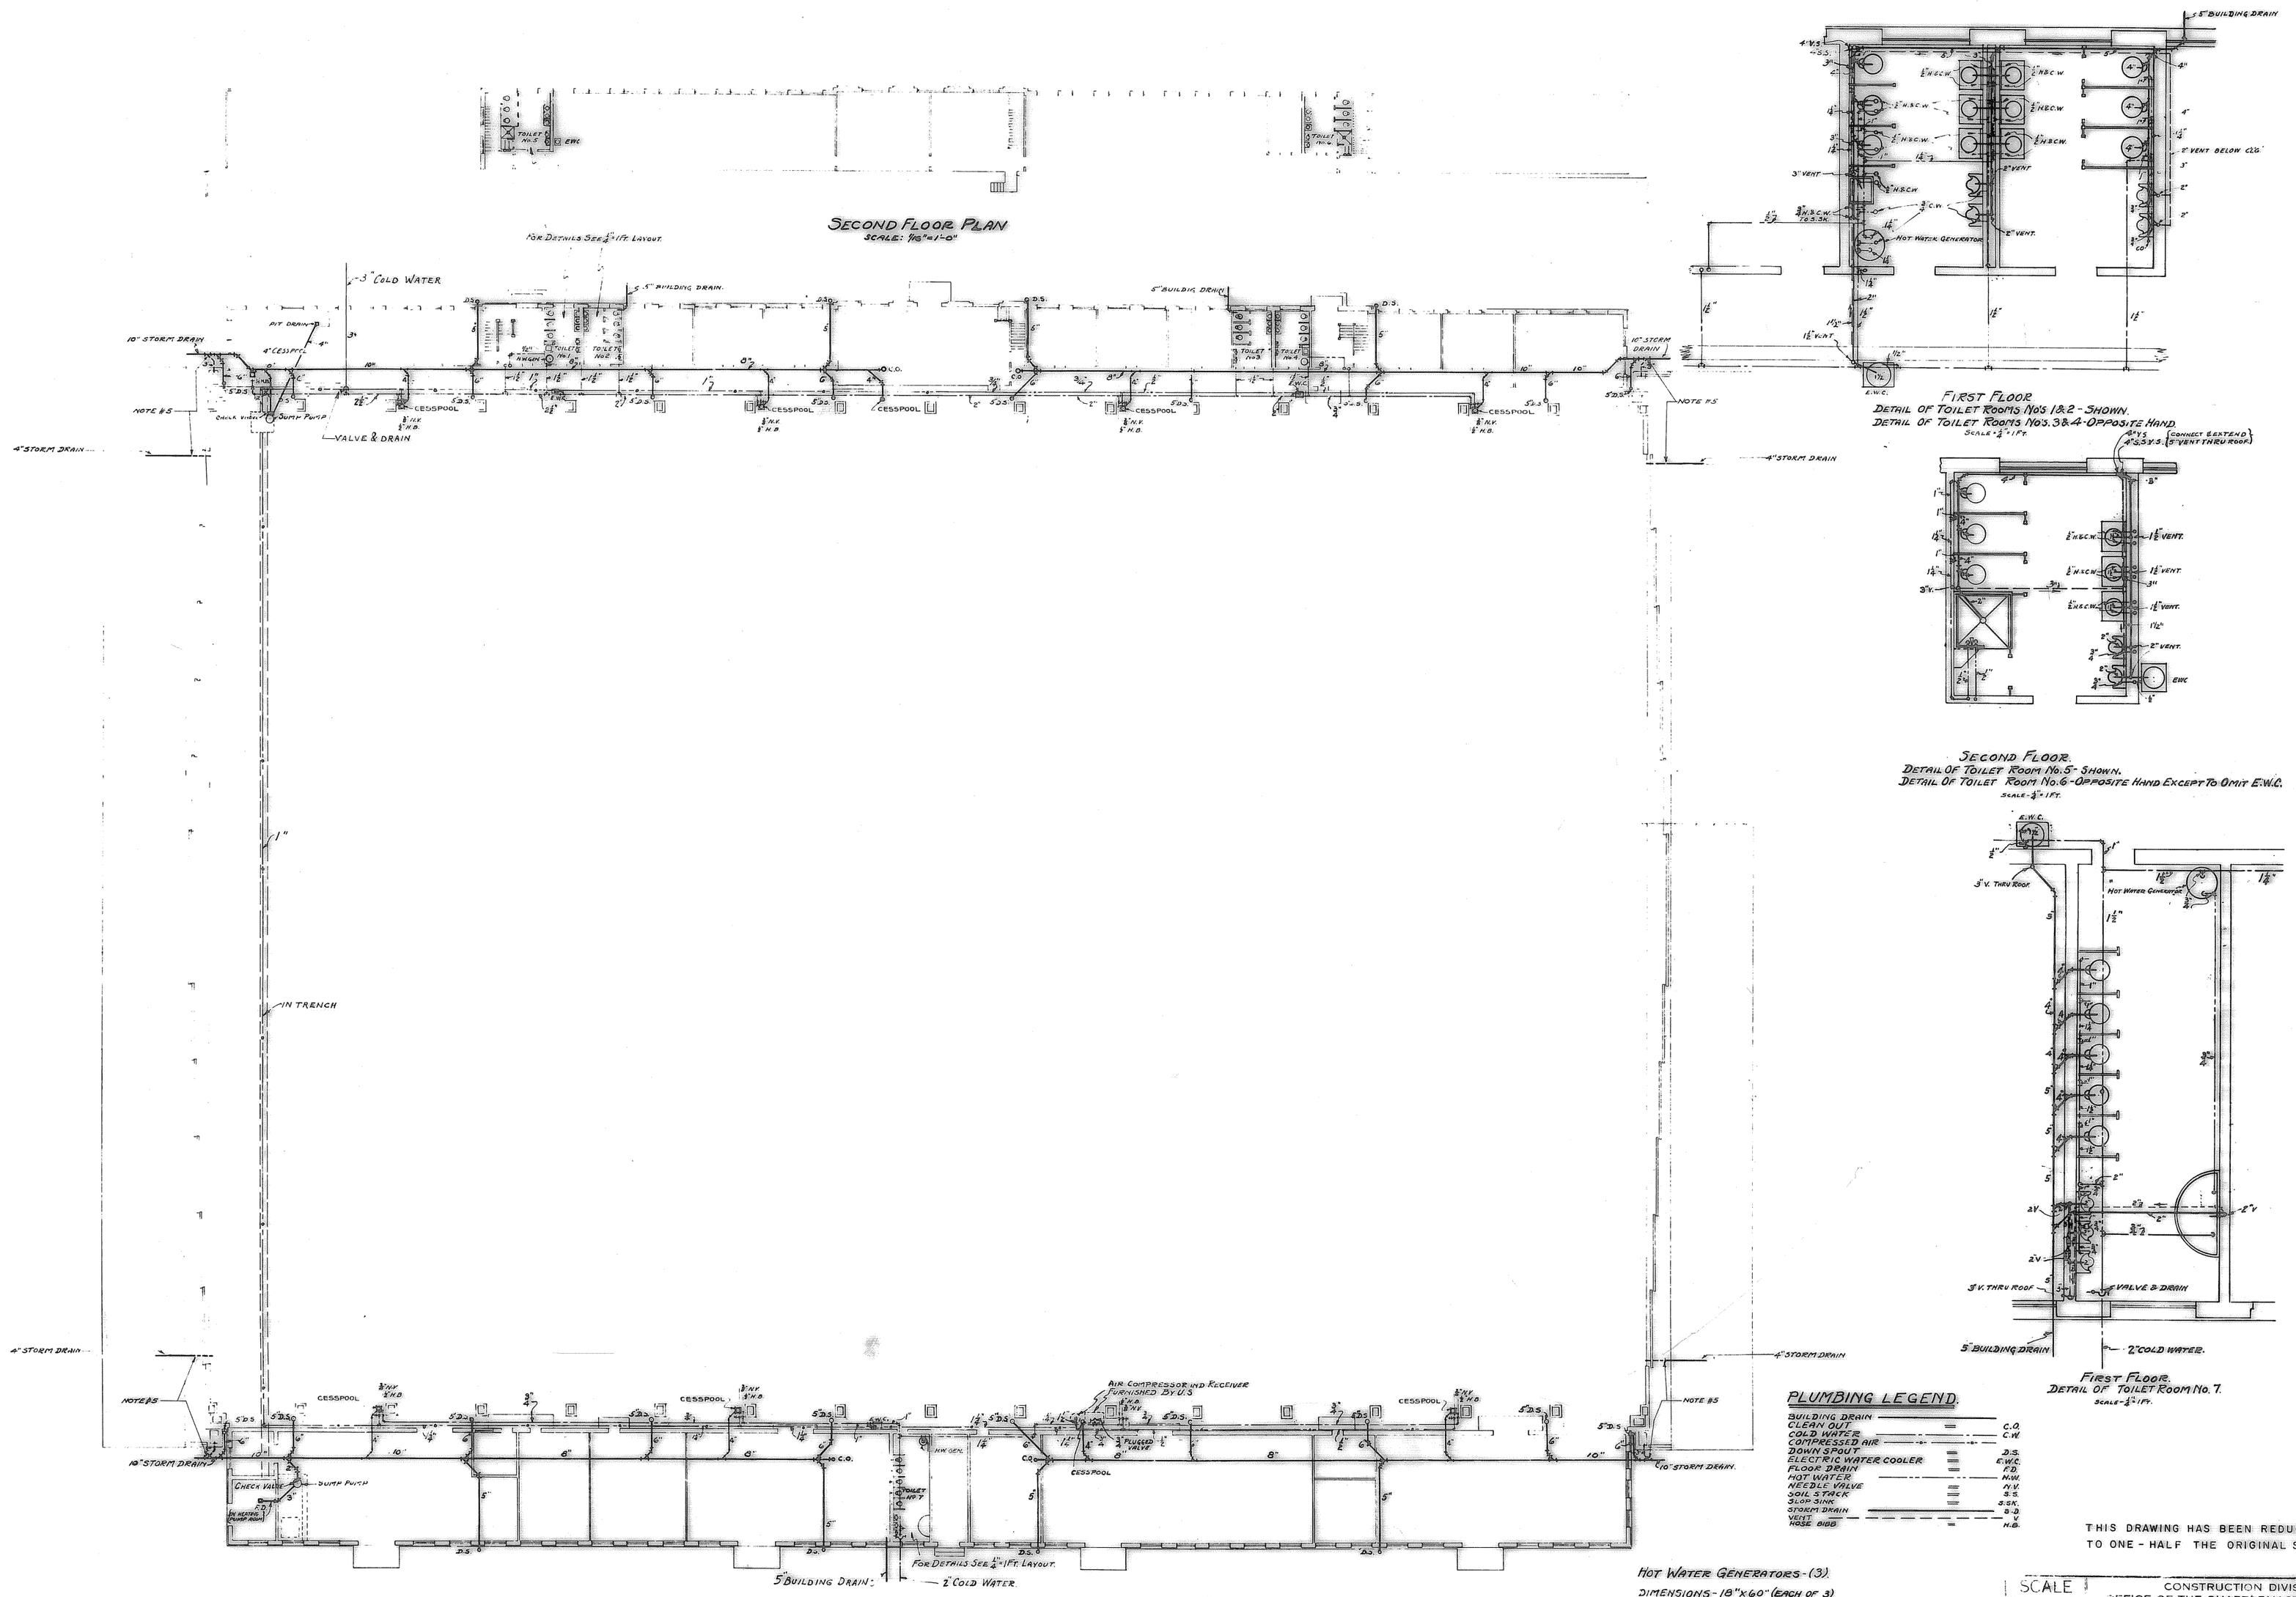

PLUMBING LEGEND.

BUILDING DRAIN		
CLEAN OUT	=	C.O.
COLD WATER		C.W.
COMPRESSED AIR		
DOWN SPOUT	=	D.S.
ELECTRIC WATER COOLER	=	E.W.C.
FLOOR DRAIN	=	F.D.
HOT WATER		H.W.
NEEDLE VALVE	=	N.V.
SOIL STACK	=	S.S.
SLOP SINK	=	S.SK.
STORM DRAIN		S.D.
VENT		V.
HOSE BIBB	=	H.B.

THIS DRAWING HAS BEEN REDUCED TO ONE - HALF THE ORIGINAL SCALE

NOTES:-

1. ALL HOSE BIBBS TO BE 1/2"
2. ALL NEEDLE VALVES ON COMPRESSED AIR LINE TO BE 3/8"
3. DRAWINGS ARE GENERALLY DIAGRAMMATIC AND INDICATIVE OF WORK TO BE INSTALLED.
4. ALL OVERHEAD PIPING SHALL BE RUN PARALLEL TO LINES OF TRUSSES AND SHALL BE SUPPORTED AS SPECIFIED.
5. CONNECT AT THIS POINT TO TRENCH & PIT DRAINS FURNISHED BY U.S.

HOT WATER GENERATORS - (3).

DIMENSIONS - 18" x 60" (EACH OF 3)
STORAGE CAPACITY = 65 GAL. (EACH OF 3)
SQUARE FEET HEATING SURFACE
H.W. GEN. LOCATED IN TOILETS Nº 1 & Nº 4 — 3.4 SQ. FT. EACH
H.W. GEN. LOCATED IN TOILET Nº 7 — 1.0 SQ. FT.

SUMP PUMP. (2).

CAPACITY 15 GALS. PER MINUTE.
TOTAL DYNAMIC HEAD 15 FT.

ELECTRIC WATER COOLERS

COOLING CAPACITY 5 G.P.H.

SCALE AS NOTED
REVISIONS

CONSTRUCTION DIVISION
OFFICE OF THE QUARTERMASTER GENERAL

SCOTT · FIELD · ILL ·
COMPLETION OF A.C. HANGAR NO. 1.
AND ANNEXES
PLUMBING

DRAWN BY	CHECKED BY	APPROVED BY DIRECTION	DATE
C.R. HANNA			APRIL 10, 1920
TRACED BY C.R. HANNA		CAPT., Q.M.C.	PLAN NUMBER 6626-25