



**LIGHTING FIXTURE TYPE "F"**  
**MOUNTING DETAIL**  
 SCALE: 1/2" = 1'-0"  
 0 1' 2' 4'

**OCCUPANCY SENSOR PROGRAM SCHEDULE:**


SENSOR TYPE	ON CONTROL	OFF CONTROL	OFF TIME DELAY	ROOM
INFRARED	MANUAL ONLY	MANUAL/SENSOR	AUTO OFF AFTER 15 MINUTES	TYPICAL OFFICES
DUAL TECHNOLOGY	SENSOR	SENSOR	AUTO OFF AFTER 15 MINUTES	CONFERENCE L-C-410
DUAL TECHNOLOGY	MANUAL/SENSOR	MANUAL/SENSOR	AUTO OFF AFTER 15 MINUTES	ENT/LIBRARY L-C-420

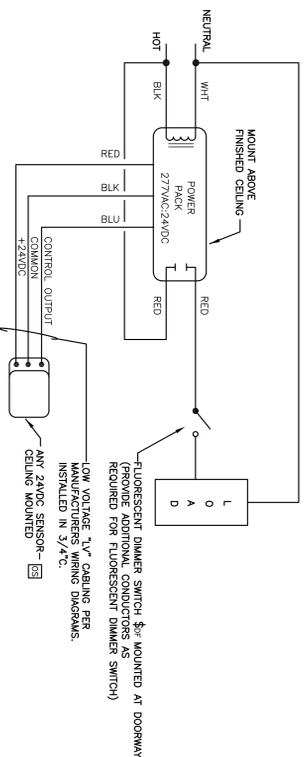

**OCCUPANCY SENSOR WITH DIMMER SWITCH**  
**TYPICAL WIRING DIAGRAM**  
 NOT TO SCALE

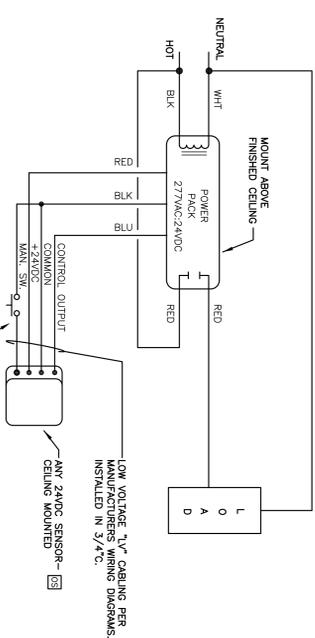

**OCCUPANCY SENSOR WITH WALL SWITCH**  
**TYPICAL WIRING DIAGRAM**  
 NOT TO SCALE

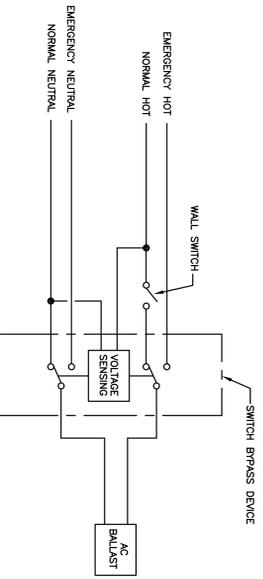


**GENERATOR TRANSFER DEVICE (GTD)**  
**TYPICAL WIRING DIAGRAM**  
 NOT TO SCALE

**Revisions:**

Bid Issue	Date
05-16-08	

**CONSULTANTS:**

**FREDERICK, FREDERICK & HEHLER**  
 ARCHITECTS  
 872 EAST ROXBOROUGH ROAD  
 BROADVIEW HTS., OHIO 44147  
 TEL: (440) 246-4988  
 FAX: (440) 246-4999



**ARCHITECT:**

**Perspectus**  
 ARCHITECTS  
 15212 Shaker Square Suite 204 Cleveland, Ohio 44120  
 P: 216.752.1000  
 F: 216.752.2833

**ELECTRICAL DETAILS**

Approved: Project Director

**Project Title**  
**PROSTHETICS RENOVATIONS**

**Location**  
**VAMC - WADE PARK**

**Date**  
 03-12-08

**Checked**  
 MPL

**Drawn**  
 TAG

**Dwg**  
 1-E12

**Office of Facilities Management**  
 Department of Veterans Affairs

**FULLY SPRINKLERED**