AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT

1. CONTRACT ID CODE	PAGE OF PAGES	
J	1	2

2. AMENDMENT/MODIFICATION NO.	3. EFFECTIVE DATE	4. REQUISITION/PURCHASE REQ. NO.	5. PROJECT NO.(If applicable)
0002	22-Jul-2008		

6. ISSUED BY	CODE	7. ADMINISTERED BY (If other than item 6)	CODE
CONTRACTING DIVISION USACE, LITTLE ROCK (W9127S) 700 W. CAPITOL AVE, RM 7315 LITTLE ROCK AR 72201-3225	W9127S	**See Item 6**	

8. NAME AND ADDRESS OF CONTRACTOR (No., Street, County, State and Zip Code)			
		X	9A. AMENDMENT OF SOLICITATION NO. W9127S-08-B-6000
		X	9B. DATED (SEE ITEM 11) 27-Jun-2008
			10A. MOD. OF CONTRACT/ORDER NO.
CODE	FACILITY CODE		10B. DATED (SEE ITEM 13)

11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS

[X] The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offer [ ] is extended, [X] is not extended.

Offer must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended by one of the following methods: (a) By completing Items 8 and 15, and returning 1 copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.

12. ACCOUNTING AND APPROPRIATION DATA (If required)

13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS.
IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.

[ ] A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.

[ ] B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(B).

[ ] C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:

[ ] D. OTHER (Specify type of modification and authority)

E. IMPORTANT: Contractor [ ] is not, [ ] is required to sign this document and return _____ copies to the issuing office.

14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.)

LRAFB Communications
Solicitation number W9127S-08-B-6000 is amended as shown on the following pages

Except as provided herein, all terms and conditions of the document referenced in Item 9A or 10A, as heretofore changed, remains unchanged and in full force and effect.

15A. NAME AND TITLE OF SIGNER (Type or print)		16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print) TEL: EMAIL:	
15B. CONTRACTOR/OFFEROR (Signature of person authorized to sign)	15C. DATE SIGNED	16B. UNITED STATES OF AMERICA BY (Signature of Contracting Officer)	16C. DATE SIGNED 22-Jul-2008

SECTION SF 30 BLOCK 14 CONTINUATION PAGE

The following items are applicable to this modification:
AMENDMENT 0002
TECHNICAL SPECIFICATION REVISIONS

NONE

DRAWING REVISIONS

The following Drawings are revised as described below and attached:

Drawing ES-101- Replace building reference on drawing “BUILDING 355” with “BUILDING 335”.

Drawing ES-102 – Replace keyed note #9 with “SPLICE 600-PAIR, 24 AWG CABLE AND 100-PAIR, 24 AWG CABLE TO THE 900-PAIR CABLE. INSTALL 600-PAIR CABLE TO THE WING HEADQUARTERS BUILDING AND 100-PAIR CABLE TO THE CORROSION CONTROL HANGAR BUILDING. CLEAR-CAP AND LABEL THE REMAINING 200-PAIR SPARE FOR FUTURE USE.”

Everything else remains unchanged.

GENERAL NOTES

1. DRAWING IS SHOWN A TYPICAL EXISTING DUCT SYSTEM LAYOUT.
2. REFER TO SHEET ES-102 AND ES-103 FOR DETAIL OUTSIDE PLANT CABLE WORK.

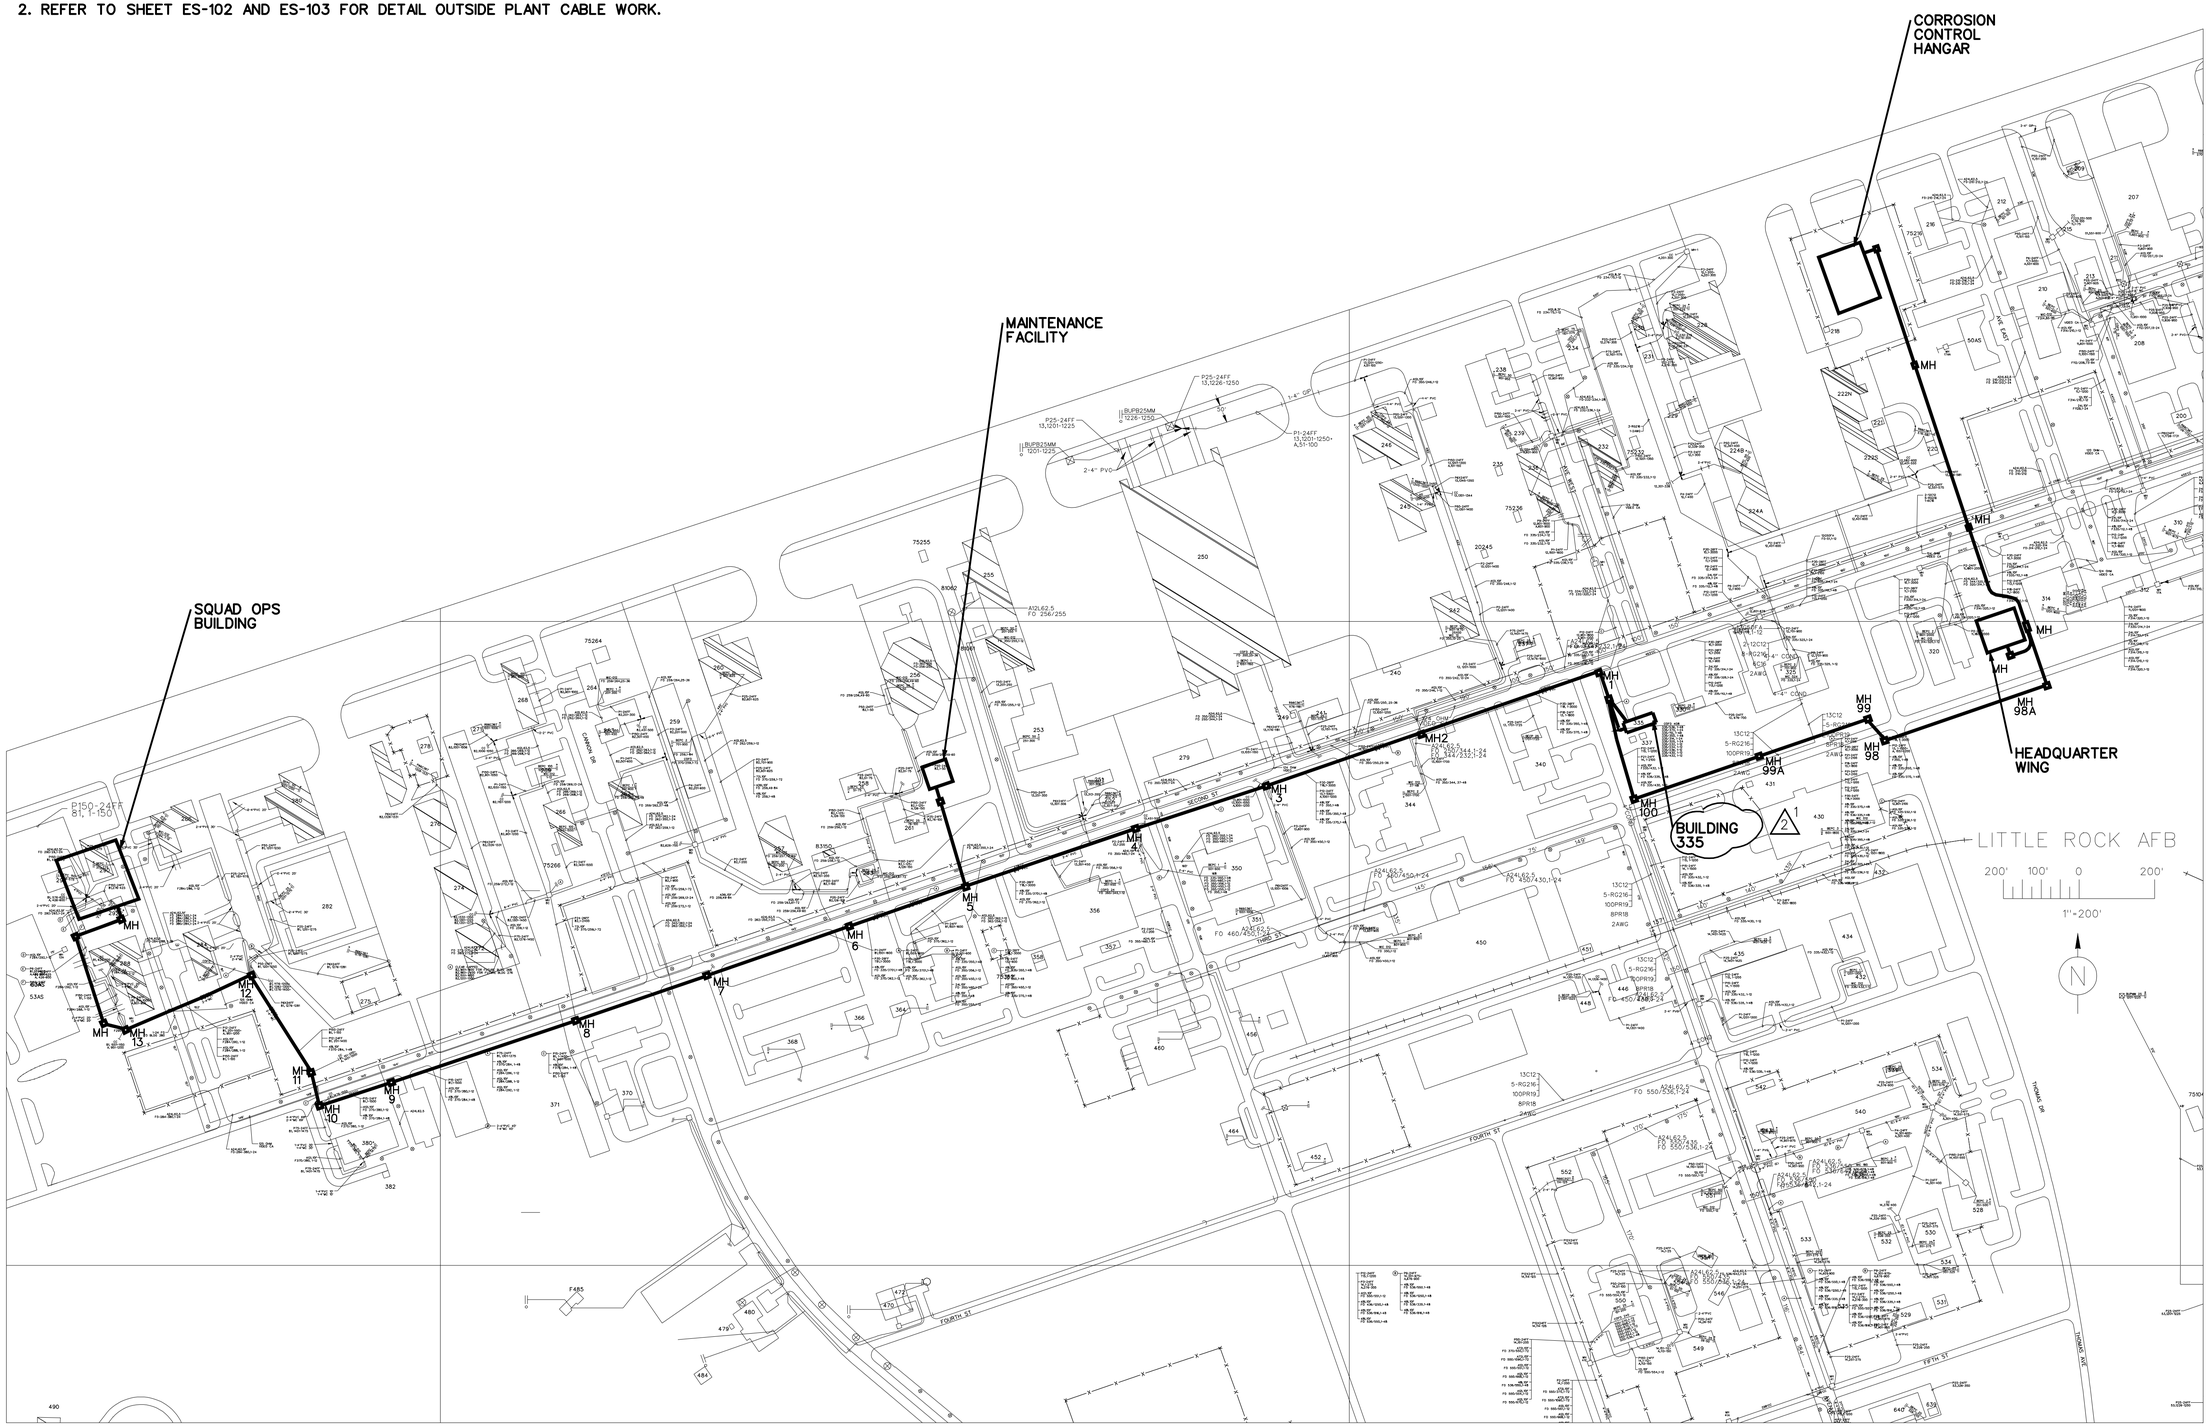

US Army Corps of Engineers
Little Rock District

Symbol	Description	Date	Appr.
1	REVISED BUILDING NUMBER. AMEND NO. 0002	07/18/08	TDD

Designed by: TDD
Date: JUNE 2008
Drawn by: NCK
Solicitation No.: W912TS-08-B-6000
Reviewed by: MME
Contract No.: W912TS-08-X-XXXX

U.S. ARMY ENGINEER DISTRICT
CORPS OF ENGINEERS
LITTLE ROCK, ARKANSAS

Submitted by:

LITTLE ROCK AIR FORCE BASE
PULASKI COUNTY, ARKANSAS

LRAFB BRAC PROJECTS COMMUNICATION
OUTSIDE PLANT CABLES

TELECOMMUNICATION SITE PLAN I

Drawing Ref. No.
ES-101.1

M4EDDTDD

H:\mil\mldt\138007\mldES-101.dgn

22-JUL-2008 14:37

AMENDMENT NO. 0002

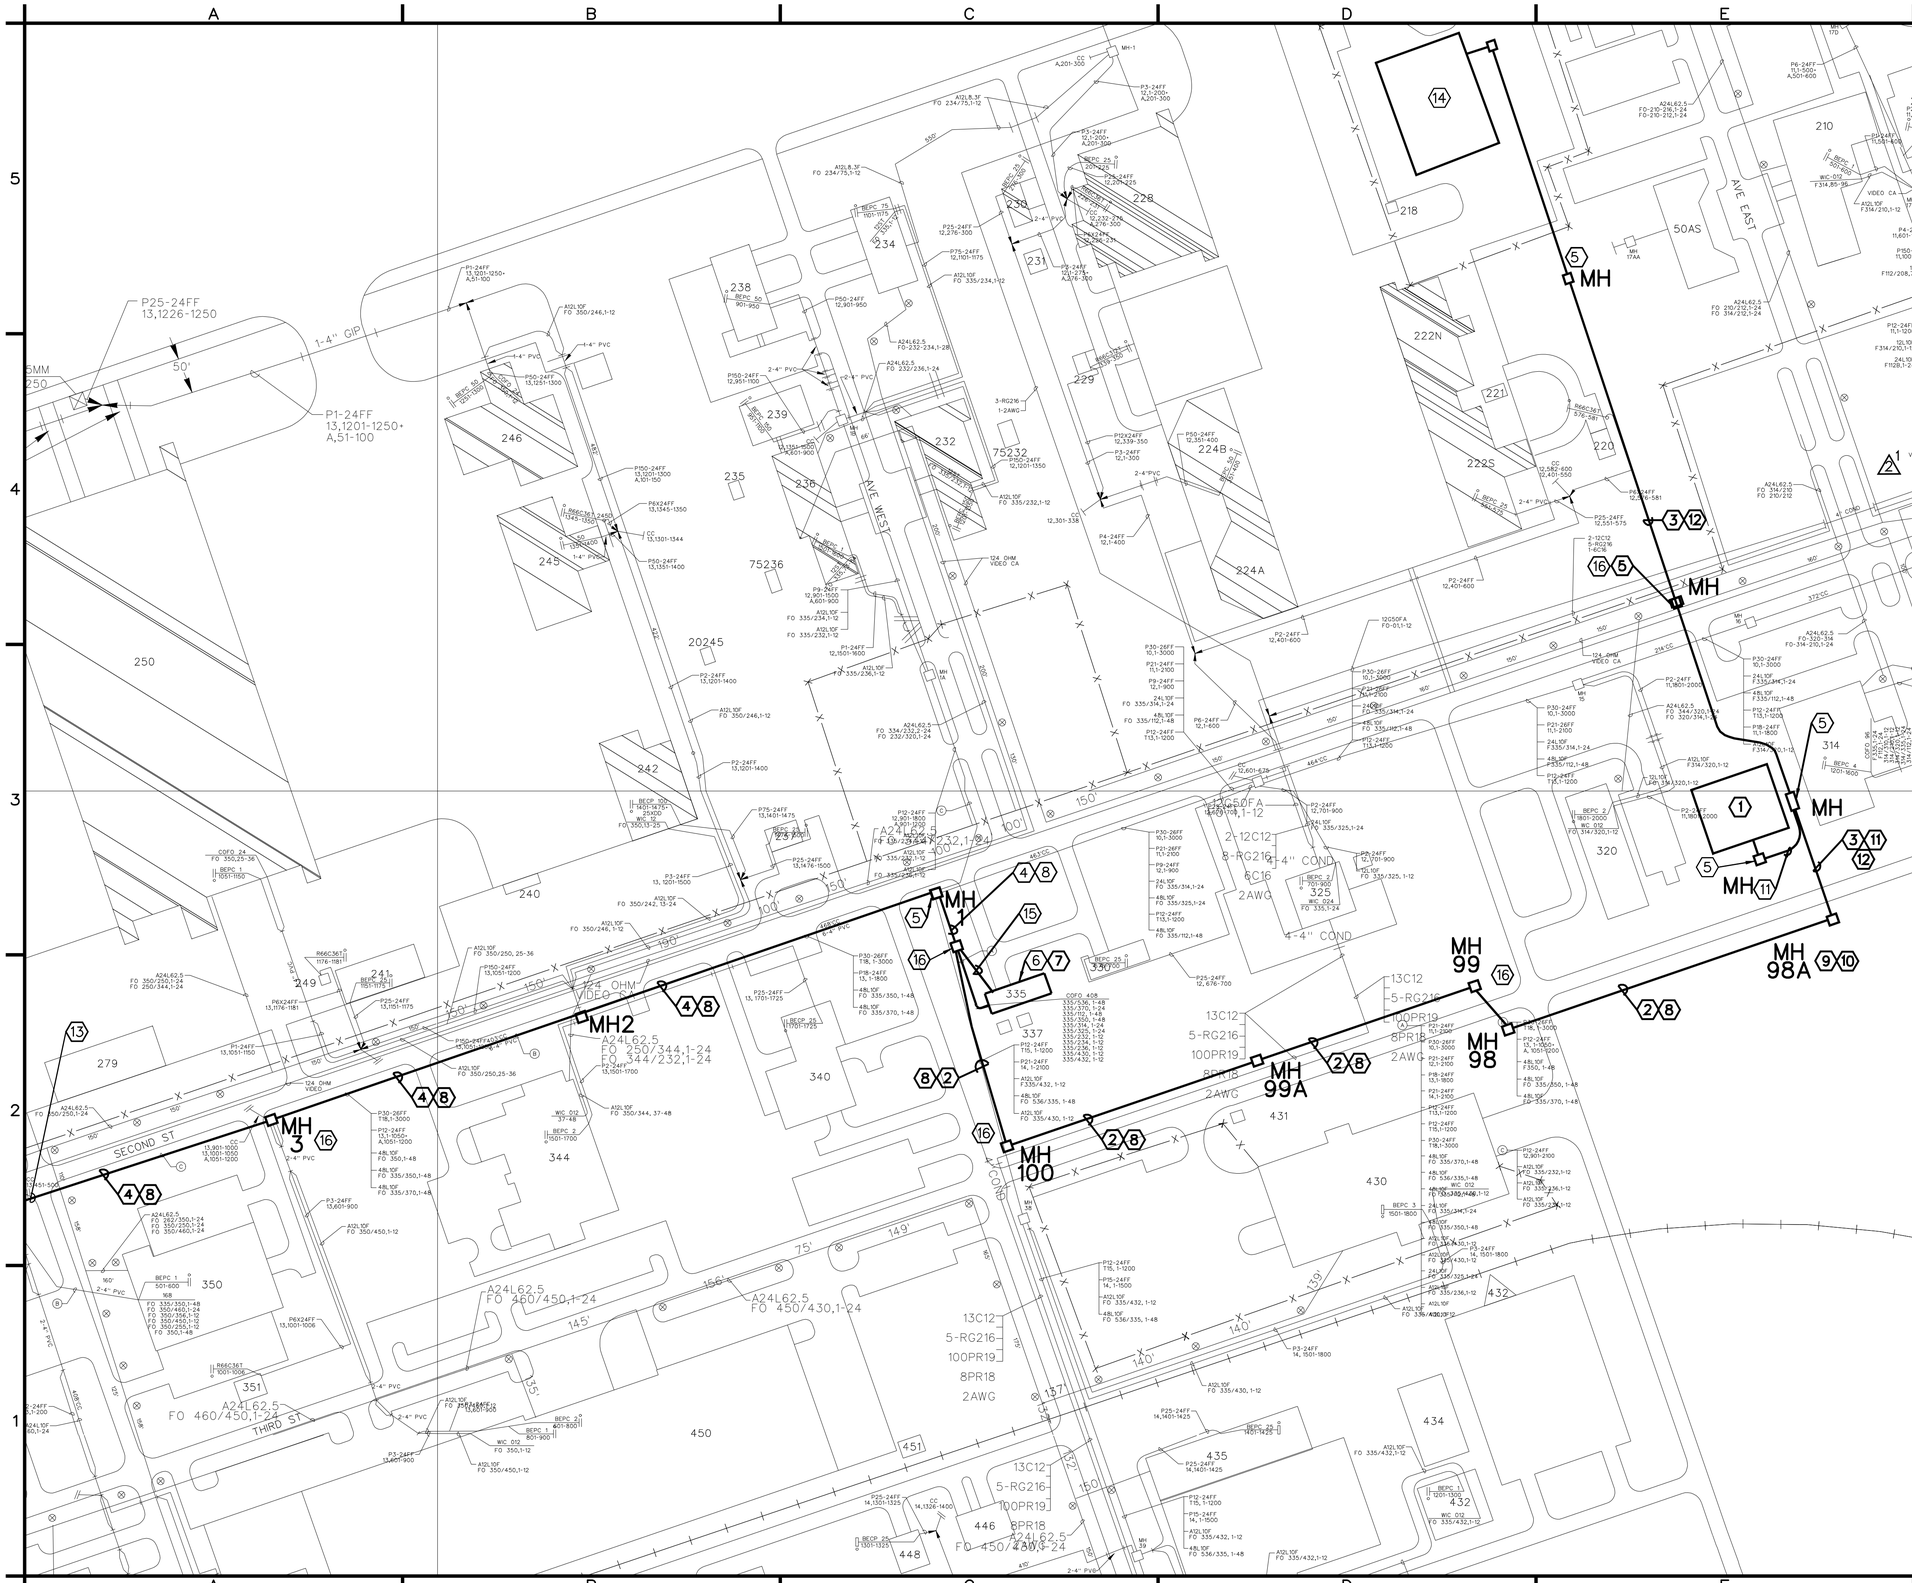

KEYED NOTES

1. WING HEADQUARTER BUILDING. SEE SHEET E-101, E-102, E-103 FOR WING HQ COMMUNICATION PLAN LAYOUT.
2. EXISTING COMMUNICATION DUCT SYSTEM (5'-5" AND 3'-4")
3. EXISTING 2'-4" DUCT.
4. EXISTING DUCT SYSTEM.
5. EXISTING TELECOMMUNICATION MANHOLE, TYPICAL.
6. LRAFB EXISTING COMMUNICATION BUILDING 335.
7. TERMINATE 1800-PAIR, 24AWG COPPER CABLE ON MAIN DISTRIBUTION FRAME WITH NEW R399 CONNECTOR TYPE WITH GAS PROTECTOR MOUDLE. PROVIDE REQUIRED CONNECTOR AND GAS PROTECTOR MODULES. SEE SHEET E-113.
8. INSTALL 900-PAIR, 24 AWG COPPER, REA RE-89 CABLE IN EXISTING DUCT SYSTEM.
9. SPLICE 600-PAIR, 24 AWG CABLE AND 100-PAIR, 24 AWG CABLE TO THE 900-PAIR CABLE. ROUTE 100-PAIR TO THE CORROSION CONTROL HANGAR BUILDING AND 600-PAIR TO WING HEADQUARTER BUILDING. CLEAR-CAP AND LABEL THE REMAINING 200-PAIR SPARE FOR FUTURE USE.
10. THERE IS AN EXISTING 24-STRAND SINGLE MODE FIBER OPTIC CABLE IN MANHOLE FOR SPLICING. CONTRACTOR SHALL MAKE FUSION SPLICE CONNECTION TO THE EXISTING 24-STRAND SINGLE MODE AND ROUTE 12-STAND SINGLE MODE TO THE CORROSION CONTROL HANGAR AND 12-STRAND OF SINGLE MODE FIBER TO WING HEADQUARTER BUILDING.
11. 600-PAIR, 24AWG, PE-89 AND 12-STRAND SINGLE MODE FIBER OPTIC CABLE TO WING HEADQUARTER BUILDING COMMUNICATION ROOM.
12. 100-PAIR, 24 AWG, PE-89 AND 12-STRAND SINGLE MODE FIBER OPTIC CABLE TO CORROSION CONTROL HANGAR COMMUNICATION ROOM.
13. CONTINUE ON SHEET ES-103.
14. TO CORROSION CONTROL HANGAR. SEE SHEET E-111 AND E-112 FOR COMMUNICATION PLAN LAYOUT.
15. INSTALL ONE 1800-PAIR, 24 AWG, RE 89 CABLES IN EXSTING DUCT SYSTEM.
16. PROVIDE COPPER SPLICE AT THIS LOCATION.

US Army Corps of Engineers
Little Rock District

Symbol	Description	Date	Appr.
1	REVISED KEYED NOTE #9, AMEND NO. 0002	07/18/08	TDD

Designed by: TDD
Drawn by: NCK
Reviewed by: MME
Date: JUNE 2008
Solicitation No.: W912TS-08-B-6000
Contract No.: W912TS-08-X-XXXX

U.S. ARMY ENGINEER DISTRICT
CORPS OF ENGINEERS
LITTLE ROCK, ARKANSAS
Submitted by:

LITTLE ROCK AIR FORCE BASE
PULASKI COUNTY, ARKANSAS

LRAFB BRAC PROJECTS COMMUNICATION OUTSIDE PLANT CABLES

TELECOMMUNICATION SITE PLAN II

Drawing Ref. No.
ES-102.1

AMENDMENT NO. 0002

M4EDDTDD

H:\mil\ml\mldt\138007\mldtES-102.dgn

22-JUL-2008 14:37