NOTES:

1. REBALANCE AIR FLOWS FOR THESE ROOMS AS SHOWN.
2. PROVIDE WOOD ACCESS PLATFORMS BOTH SIDES OF (N) CHWC-4 & 7.
3. REPLACE ALL CEILING DIFFUSERS W/ ANEMOSTAT RMD-P SUPPLY DIFFUSERS & ANEMOSTAT 3P RETURN & EXHAUST DIFFUSERS. USE SAME SIZE AS (E) & MATCH (E) COLORS. SUPPLY & RETURN CEILING DIFFUSERS SHALL HAVE KEY OPERATED OPPOSED BLADE DAMPERS.

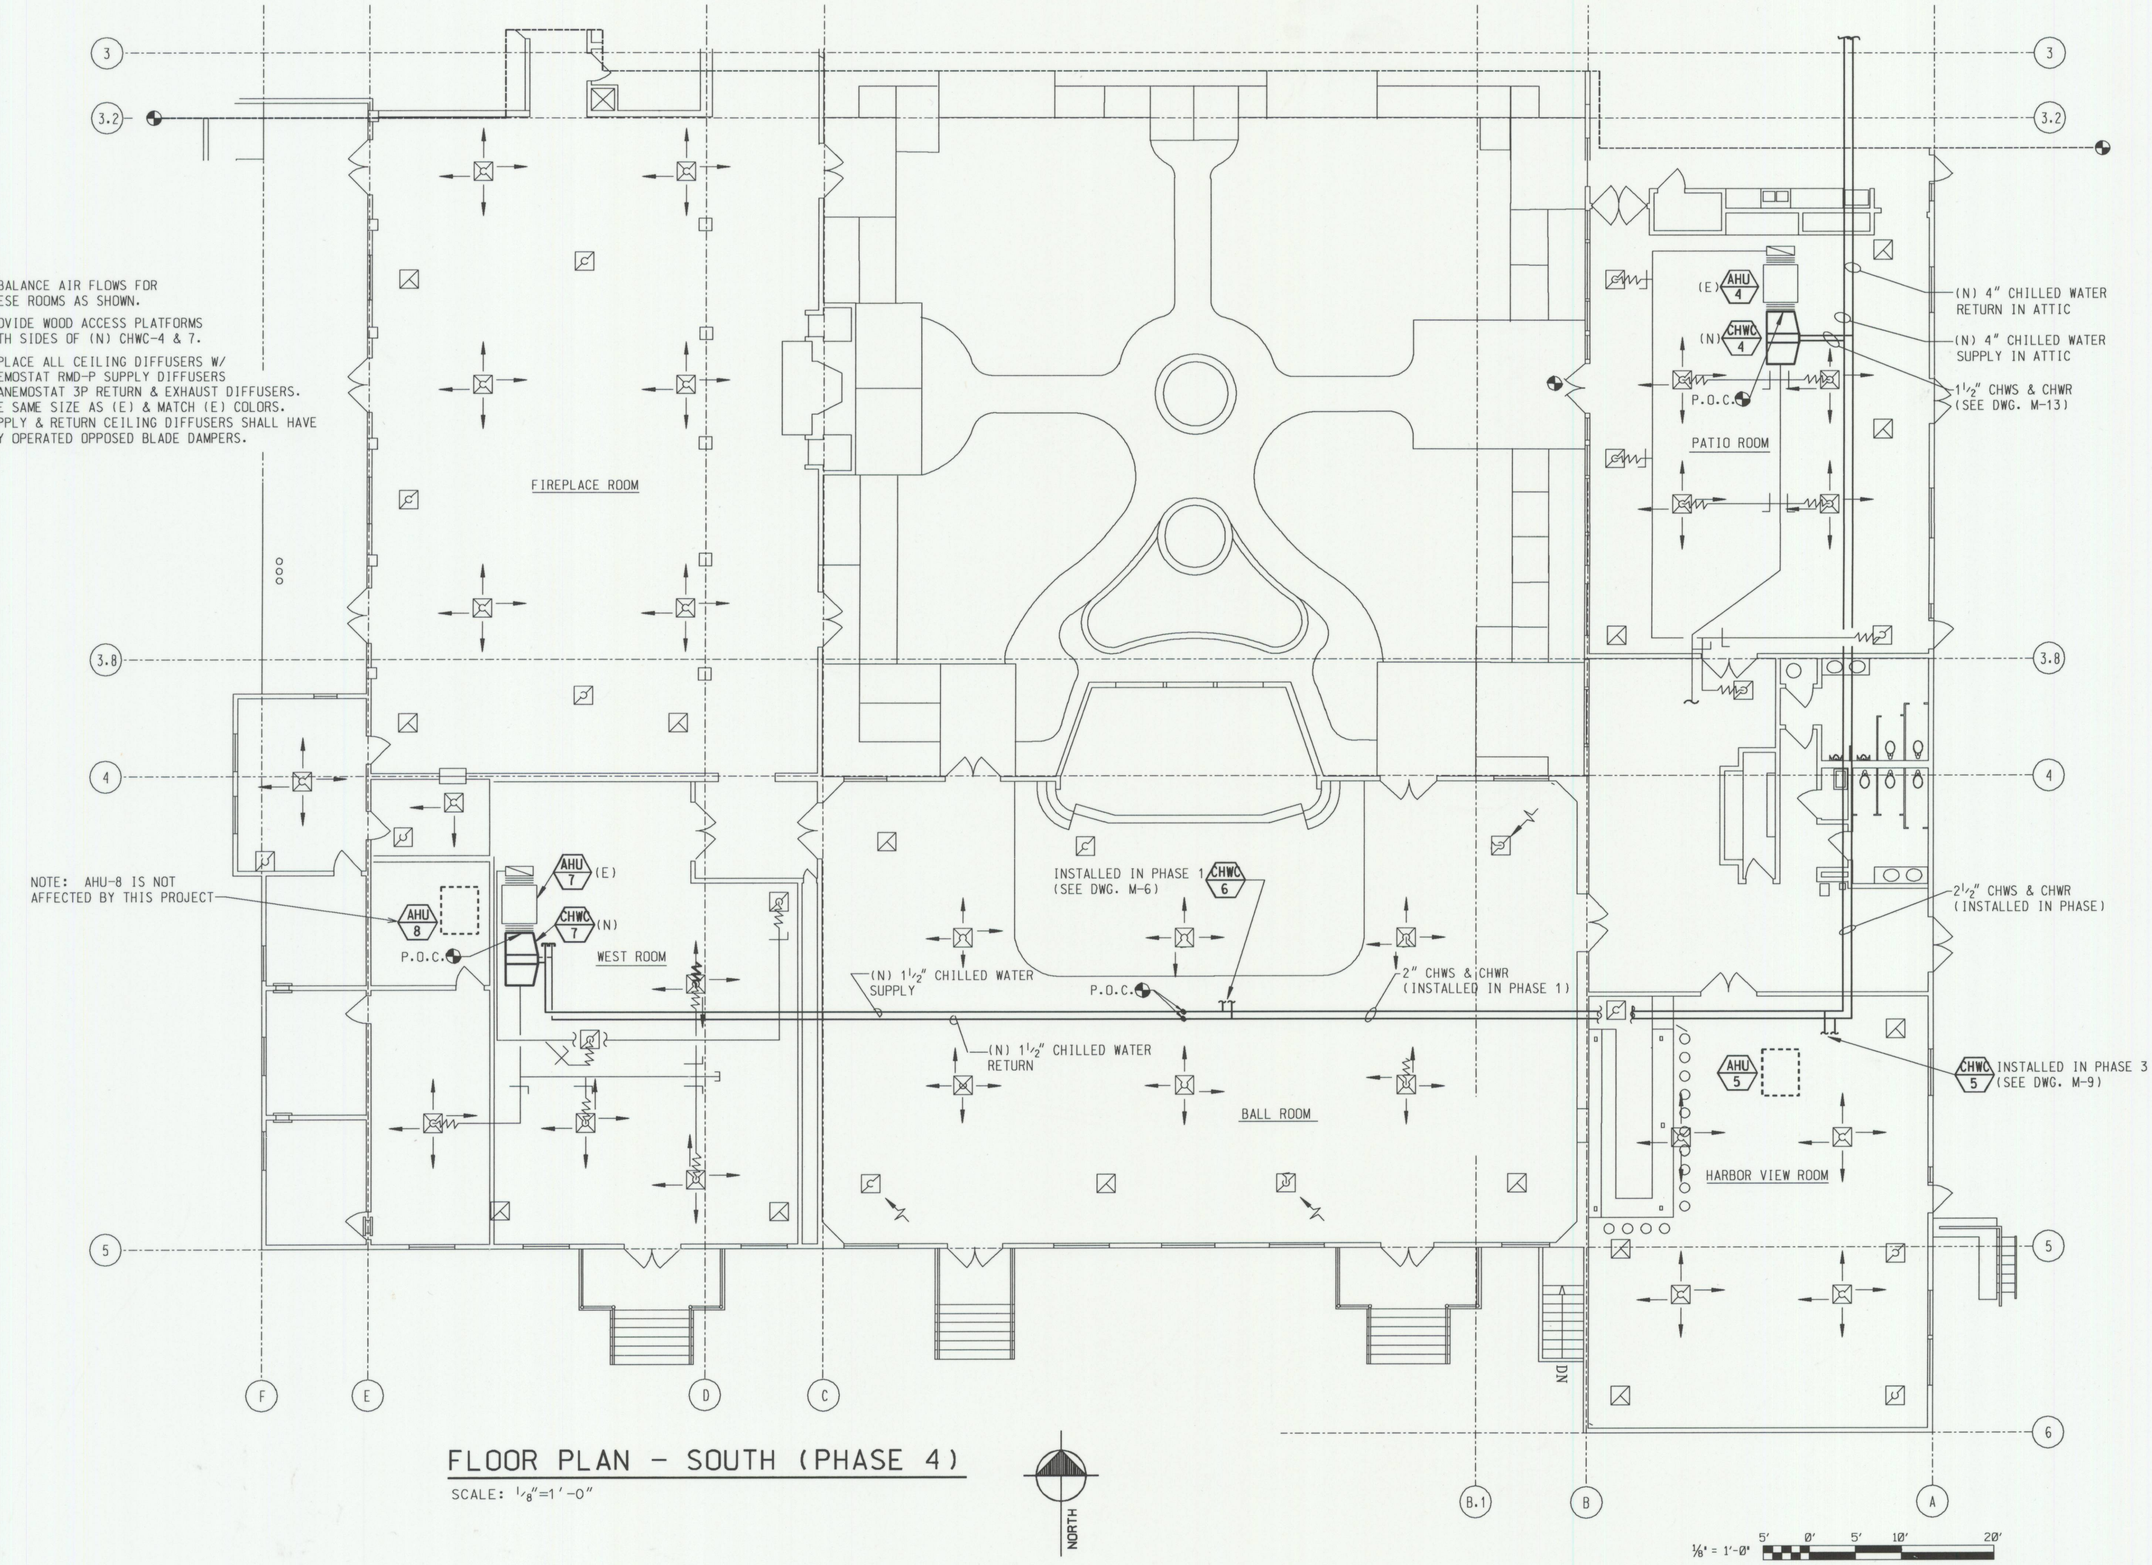

FLOOR PLAN - SOUTH (PHASE 4)

SCALE: ⅛"=1'-0"

REV. NO.	DATE	DESCRIPTION	AGENCY	BY

		DATE
APPROVED	PROJECT MANAGER	
	SECURITY	
	ENVIRONMENTAL	
	SAFETY DIVISION	
	CHIEF FIRE PROTECTION	
	COMMUNICATIONS ENGINEER	
	BIOENVIRONMENTAL ENGINEER	
	CHIEF OPERATION & MAINTENANCE	

		DATE
APPROVED	USING AGENCY	
	BASE CIVIL ENGINEER	
	CONTRACT MGT.	

		DATE
DESIGNED BY	JOHN WILLIAMS	6/15/97
DRAWN BY	JOSE IRAHETA	6/15/97
CHECKED BY	JOHN WILLIAMS	6/15/97
SUBMITTED BY	JOHN HOLLAND	6/15/97

JOB No. 10-50104-18B

MERIT ENGINEERING, INC.
129 SOUTH SAN FERNANDO BLVD.
BURBANK, CA 91502
(818) 842-2820 FAX (818) 842-1419

UNITED STATES AIR FORCE
61 AIR BASE GROUP (ABG)
LOS ANGELES AIR FORCE BASE

PROJECT TITLE: BLDG 403 HVAC (PHASE 4)
COMMUNITY CENTER
FORT MacARTHUR

SHEET TITLE: FLOOR PLAN - SOUTH (PHASE 4)

DRAWING NO. HHEK - 95-0019

DATE: 6/15/97

SCALE: ⅛" = 1'-0"

M-12

SHEET: 12 OF 16